



Trusted TMR 24 Vdc Digital Output Module – 40 Channel

PD-T8451 Issue 15

Rockwell Automation Publication ICSTT-RM2800-EN-P
Supersedes Publication ICSTT-RM280N-EN-P



Important User Information

Read this document and the documents listed in the additional resources section about installation, configuration, and operation of this equipment before you install, configure, operate, or maintain this product. Users are required to familiarize themselves with installation and wiring instructions in addition to requirements of all applicable codes, laws, and standards.

Activities including installation, adjustments, putting into service, use, assembly, disassembly, and maintenance are required to be carried out by suitably trained personnel in accordance with applicable code of practice.

If this equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

In no event will Rockwell Automation, Inc. be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Rockwell Automation, Inc. cannot assume responsibility or liability for actual use based on the examples and diagrams.

No patent liability is assumed by Rockwell Automation, Inc. with respect to use of information, circuits, equipment, or software described in this manual.

Reproduction of the contents of this manual, in whole or in part, without written permission of Rockwell Automation, Inc., is prohibited.

Throughout this manual, when necessary, we use notes to make you aware of safety considerations.



WARNING: Identifies information about practices or circumstances that can cause an explosion in a hazardous environment, which may lead to personal injury or death, property damage, or economic loss.



ATTENTION: Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss. Attentions help you identify a hazard, avoid a hazard, and recognize the consequence.

IMPORTANT Identifies information that is critical for successful application and understanding of the product.

Labels may also be on or inside the equipment to provide specific precautions.



SHOCK HAZARD: Labels may be on or inside the equipment, for example, a drive or motor, to alert people that dangerous voltage may be present.



BURN HAZARD: Labels may be on or inside the equipment, for example, a drive or motor, to alert people that surfaces may reach dangerous temperatures.



ARC FLASH HAZARD: Labels may be on or inside the equipment, for example, a motor control center, to alert people to potential Arc Flash. Arc Flash will cause severe injury or death. Wear proper Personal Protective Equipment (PPE). Follow ALL Regulatory requirements for safe work practices and for Personal Protective Equipment (PPE).

Rockwell Automation recognizes that some of the terms that are currently used in our industry and in this publication are not in alignment with the movement toward inclusive language in technology. We are proactively collaborating with industry peers to find alternatives to such terms and making changes to our products and content. Please excuse the use of such terms in our content while we implement these changes.

Preface	About This Publication	5
	Summary of changes	6
Product Overview		
	Chapter 1	
Description	Field Termination Unit (FTU)	10
	Field Interface Unit (FIU).....	10
	Host Interface Unit (HIU)	11
	Front Panel Unit (FPU)	11
	Line Monitoring and Output States.....	12
	Housekeeping.....	12
	Fault Detection/Testing.....	12
	Sequence of Events Characteristics	13
	Output Switch Structure.....	13
	Switch Diagnostics.....	15
	Short Circuit Protection	15
	Group Fail-Safe Switches	16
	Chapter 2	
Installation	Module Insertion and Removal	17
	Cable Selection	17
	Termination.....	18
	Module Pinout Connections.....	18
	Trusted Module Polarization/Keying	18
	Chapter 3	
Application	Module Configuration.....	21
	T8451 Complex Equipment Definition.....	21
	Rack 1: DO	22
	Rack 2: STATE.....	22
	Rack 3: AI.....	23
	Rack 4: CI	23
	Rack 5: LINE_FLT	23
	Rack 6: DISCREP	24
	Rack 7: HKEEPING	24
	Rack 8: INFO.....	25
	Sequence of Events Configuration	26
	System.INI File Configuration.....	27
	Chapter 4	
Operation	Front Panel	29
	Module Status LEDs	30

	I/O Status Indicators.....	31
Fault Finding and Maintenance	Chapter 5	
	Fault Reporting	33
	Field Wiring Faults	33
	Module Faults	33
	Companion Slot.....	34
	SmartSlot	34
	Cold Start	34
	Transfer between Active and Standby Modules.....	35
Specifications	Chapter 6	
	Specifications.....	37
History of changes	Appendix A	

About This Publication

In no event will Rockwell Automation be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment. The examples given in this manual are included solely for illustrative purposes. Because of the many variables and requirements related to any particular installation, Rockwell Automation does not assume responsibility or reliability for actual use based on the examples and diagrams.

No patent liability is assumed by Rockwell Automation, with respect to use of information, circuits, equipment, or software described in this manual.

Disclaimer

It is not intended that the information in this publication covers every possible detail about the construction, operation, or maintenance of a control system installation. You should also refer to your own local (or supplied) system safety manual, installation, and operator/maintenance manuals.

Allen-Bradley, LISTEN. THINK. SOLVE., Rockwell Automation, TechConnect, and Trusted are trademarks of Rockwell Automation, Inc.

All trademarks are acknowledged.

Revision and updating policy

This document is based on information available at the time of its publication, however, they are subject to change from time to time. The latest versions of the manuals are available at the Rockwell Automation Literature Library: rok.auto/literature.

Trusted release

This technical manual was updated for Trusted Release 4.0.

Latest product information

See the Trusted Release Note for the revision of this document applicable to the release at rok.auto/pcdc.

For the latest information about this product, review the Product Notifications and Technical Notes available at rok.auto/knowledgebase.

Some of the Articles in the Knowledgebase require a TechConnectSM Support Contract. For more information, go to Knowledgebase Document ID: IP622-[TechConnect Support Contract - Access Level & Features](#).



Tip: Sign in to your Rockwell Automation account to view Knowledgebase articles.

Summary of changes

This manual includes new and updated information. Use these reference tables to locate changed information.

Grammatical and editorial style changes are not included in this summary.

Global changes

This table identifies changes that apply to all information about a subject in the manual and the reason for the change. For example, the addition of new supported hardware, a software design change, or additional reference material would result in changes to all of the topics that deal with that subject.

Subject	Reason
Updated branding	Marketing product change

New or enhanced features

There are no new or enhanced features for this release.

The Trusted® TMR 24 Vdc Digital Output Module interfaces to 40 field devices. Triplicated diagnostic tests are performed throughout the Module including measurements for current, and voltage on each portion of the voted output channel. Tests are also performed for stuck on and stuck off failures. Fault tolerance is achieved through a Triple Modular Redundant (TMR) architecture within the Module for each of the 40 output channels.

Automatic line monitoring of the field device is provided. This feature enables the Module to detect both open and short circuit failures in field wiring and load devices.

The Module provides onboard Sequence of Events (SOE) reporting with a resolution of 1 ms. An output change of state triggers an SOE entry. Output states are automatically determined by voltage and current measurements onboard the Module.

This Module is not approved for direct connection to hazardous areas and should be used in conjunction with Intrinsic Safety Barrier devices.

Features

- 40 Triple Modular Redundant (TMR) output points per Module.
- Comprehensive, automatic diagnostics and self-test.
- Automatic line monitoring per point to detect open circuit and short circuit field wiring and load faults.
- 2500V impulse withstand opto/galvanic isolation barrier.
- Automatic overcurrent protection (per channel), no external fuses required.
- Onboard Sequence of Events (SOE) reporting with 1 ms resolution.
- Module can be hot-replaced online using dedicated Companion (adjacent) Slot or SmartSlot (one spare slot for many Modules) configurations.
- Front Panel output status light-emitting diodes (LEDs) for each point indicate output status and field wiring faults.
- Front Panel Module status LEDs indicate Module health and operational mode (Active, Standby, Educated).
- TÜV Certified IEC 61508 SIL 3.
- Outputs are powered in isolated groups of eight. Each such group is a Power Group (PG).

Description

The TMR 24 Vdc Digital Output Module is a member of the Trusted range of input/output (I/O) Modules. All Trusted I/O Modules share common functionality and form. At the most general level, all I/O Modules interface to the Inter-Module Bus (IMB) which provides power and allows communication with the TMR Processor. In addition, all Modules have a field interface that is used to connect to Module-specific signals in the field. All Modules are Triple Modular Redundant (TMR).

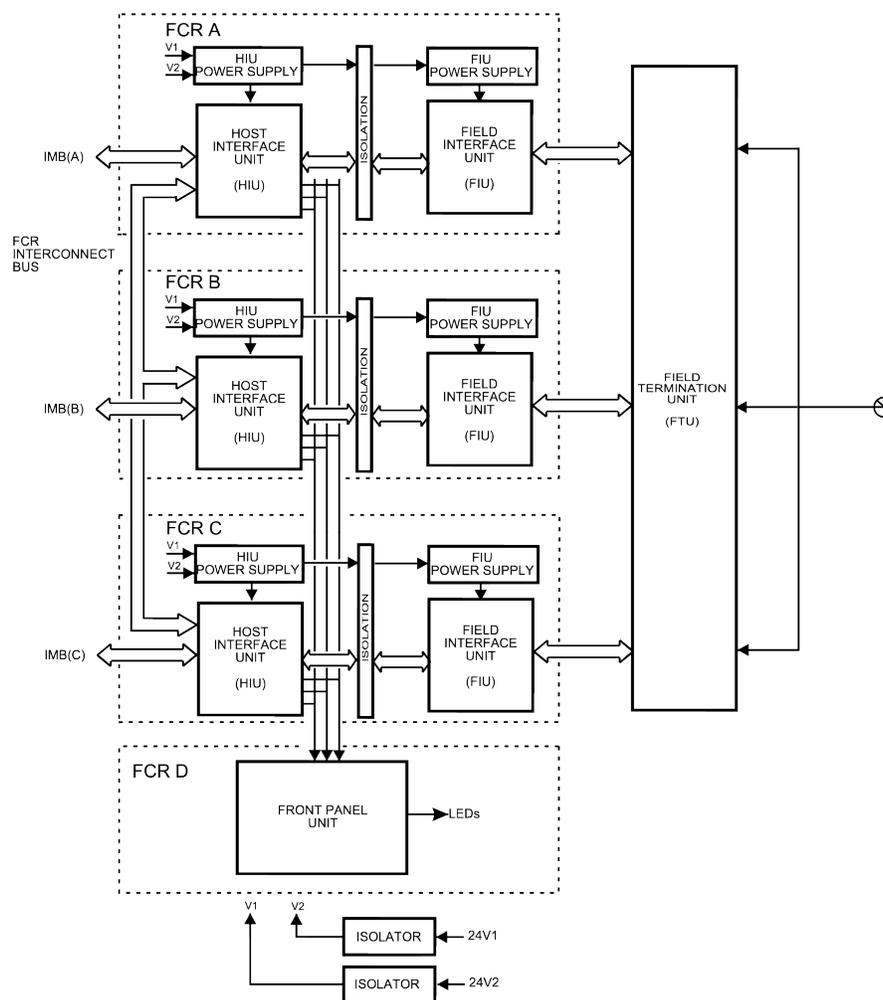


Figure 1: Module Architecture

All High Integrity I/O Modules are made up of four sections: Host Interface Unit (HIU), the Field Interface Unit (FIU), the Field Termination Unit (FTU), and the Front Panel Unit (or FPU).

Figure 2 shows a simplified block diagram of the Trusted 24 Vdc Digital Output Module.

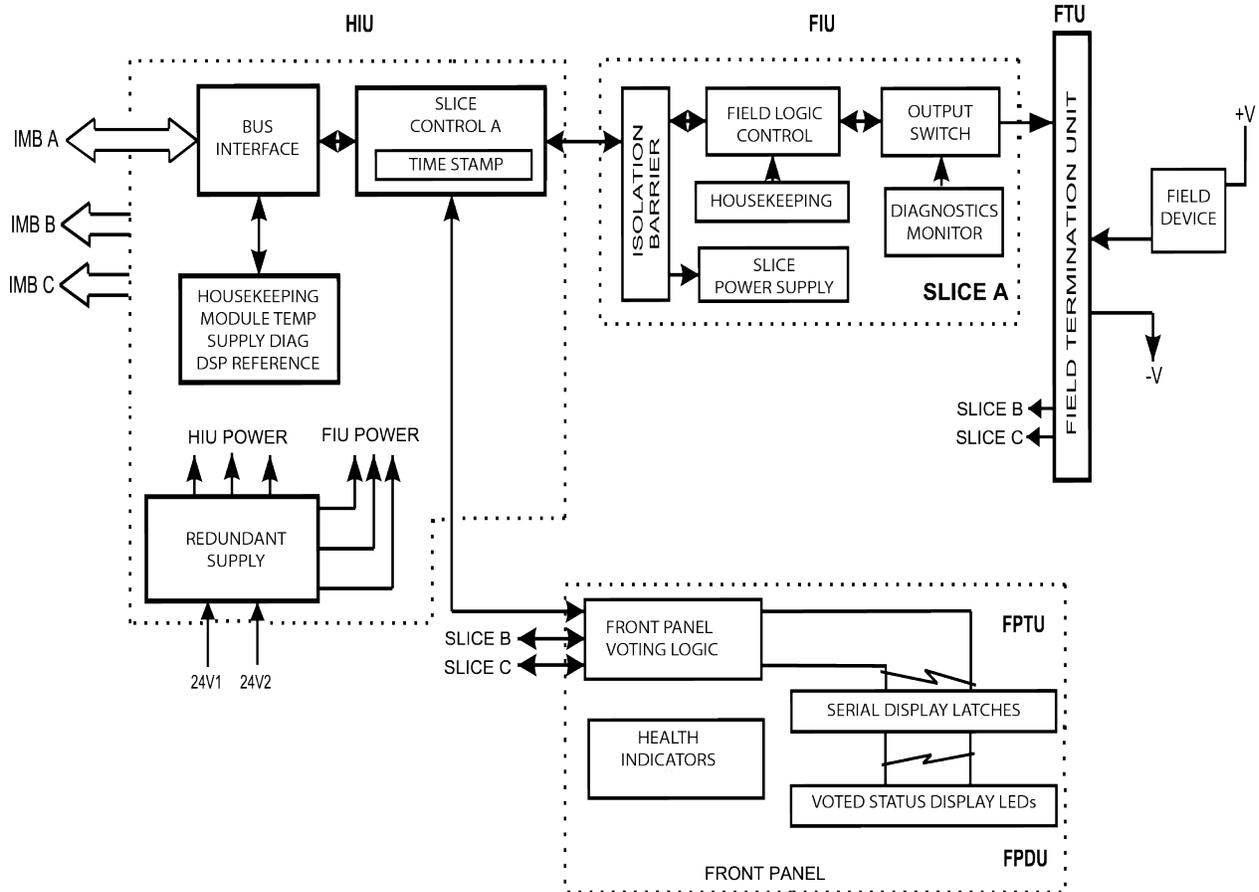


Figure 2: Functional Block Diagram

Field Termination Unit (FTU)

The Field Termination Unit (FTU) is the section of the I/O Module that connects all three FIUs to a single field interface. The FTU provides the Group Fail-Safe Switches and passive components necessary for signal conditioning, overvoltage protection, and EMI/RFI filtering. When installed in a Trusted Controller or Expander Chassis, the FTU field connector interconnects to the Field I/O Cable Assembly attached at the rear of the Chassis.

The SmartSlot link is passed from the HIU to the field connections via the FTU. These signals go directly to the field connector and maintain isolation from the I/O signals on the FTU. The SmartSlot link is the intelligent connection between Active and Standby Modules for coordination during Module replacement.

Field Interface Unit (FIU)

The Field Interface Unit (FIU) is the section of the Module that contains the specific circuits necessary to interface to the particular types of field I/O signals. Each Module has three FIUs, one per slice. For the TMR 24 Vdc Digital Output Module, the FIU contains one stage of the output switch structure,

and sigma-delta ($\Sigma\Delta$) output circuit for each of the 40 field outputs. Two additional $\Sigma\Delta$ circuits provide optional monitoring of the external field I/O supply voltage.

The FIU receives isolated power from the HIU for logic. The FIU provides additional power conditioning for the operational voltages required by the FIU circuitry. An isolated 6.25 Mbit/sec serial link connects each FIU to one of the HIU slices.

The FIU also measures a range of onboard "housekeeping" signals that assist in monitoring the performance and operating conditions of the Module. These signals include power supply voltages, current consumption, onboard reference voltages and board temperature.

Host Interface Unit (HIU)

The HIU is the point of access to the Inter-Module Bus (IMB) for the Module. It also provides power distribution and local programmable processing power. The HIU is the only section of the I/O Module to directly connect to the IMB Backplane. The HIU is common to most high integrity I/O types and has type dependent and product range common functions. Each HIU contains three independent slices, commonly referred to as A, B, and C.

All interconnections between the three slices incorporate isolation to help prevent any fault interaction between the slices. Each slice is considered a Fault Containment Region (FCR), as a fault on one slice has no effect on the operation of the other slices.

The HIU provides the following services common to the Modules in the family:

- High-Speed Fault Tolerant Communications with the TMR Processor via the IMB interface.
- FCR Interconnect Bus between slices to vote incoming IMB data and distribute outgoing I/O Module data to the IMB.
- Galvanically isolated serial data interface to the FIU slices.
- Redundant power sharing of dual 24 Vdc chassis supply voltage and power regulation for logic power to HIU circuitry.
- Magnetically isolated power to the FIU slices.
- Serial data interface to the FPU for Module status LEDs.
- SmartSlot link between Active and Standby Modules for coordination during Module replacement.
- Digital Signal Processing to perform local data reduction and self-diagnostics.
- Local memory resources for storing Module operation, configuration, and field I/O data.
- Onboard housekeeping, which monitors reference voltages, current consumption and board temperature.

Front Panel Unit (FPU)

The Front Panel Unit (FPU) contains the necessary connectors, switches, logic, and LED indicators for the Front Panel. For every type of Trusted I/O Module, the FPU contains the Slice Healthy, Active/Standby, the Educated

LED indicators, and the Module removal switches. Additional bicolor LEDs provide status indication for the individual I/O signals. Serial data interfaces connect the FPU to each of the HIU slices to control the LED status indicators and monitor the Module removal switches.

Line Monitoring and Output States

The Module automatically monitors the output channel current and voltage to determine the state of the output channel. The numerical output state and line fault status are reported back to the application and are represented in this table:

Table 1 Line Monitoring Fault Status

Description	Numerical Output State	Line Fault Status
Field Short Circuit	5	1
Output Energized (On)	4	0
No Load, Field Open Circuit	3	1
Output De-energized (Off)	2	0
No Field Supply Voltage	1	1

It is recommended to fit a dummy load resistor to unused outputs so that a current is drawn that exceeds the NO-LOAD threshold. This will help prevent the Module from signaling a NO-LOAD fault

Housekeeping

The Output Module automatically performs local measurements of several onboard signals that can be used for detailed troubleshooting and verification of Module operating characteristics. Measurements are made within each slice's HIU and FIU.

Fault Detection/Testing

Extensive diagnostics provide the automatic detection of Module faults. The TMR architecture of the Output Module and the diagnostics performed verify the validity of all critical circuits. Using the TMR architecture provides a Fault Tolerant method to withstand the first fault occurrence on the Module and continue normal output controls without interruption in the system or process. Faults are reported to the user through the Healthy status indicators on the Front Panel of the Module and through the information reported to the TMR Processor. Under normal operations, all three Healthy indicators are green. When a fault occurs, one of the Healthy indicators will be flashing red. It is recommended that this condition is investigated and if the cause is within the Module, it should be replaced.

Module replacement activities depend on the type of spare Module configuration chosen when the system was configured and installed. The Module may be configured with a dedicated Companion Slot or with a SmartSlot for a spare replacement Module.

From the IMB to the field connector, the I/O Module contains extensive fault detection and integrity testing. As an output device, most testing is performed in a non-interfering mode. Data input from the IMB is stored in redundant error-correcting RAM on each slice portion of the HIU. Received data is voted on by each slice. All data transmissions include a confirmation response from the receiver.

Periodically, the TMR Processor commands the onboard Digital Signal Processors (DSPs) to perform a Safety Layer Test (SLT). The SLT results in the DSP verifying with the TMR Processor its ability to process data with integrity. In addition, the DSP uses Cyclical Redundancy Checks (CRC) to verify the variables and configuration stored in Flash memory.

Between the HIU and FIU are a series of galvanically isolated links for data and power. The datalink is synchronized and monitored for variance. Both FIU and HIU have onboard temperature sensors to characterize temperature-related problems.

The power supplies for both the HIU and FIU boards are redundant, fully instrumented and testable. Together these assemblies form a Power Integrity Subsystem.

Sequence of Events Characteristics

The Module automatically measures the field voltage and current to determine the state of each output channel. An event occurs when the output transitions from one state to another. When a channel changes state, the onboard timer value is recorded. When the TMR Processor next reads data from the Output Module, the channel state and real-time clock value are retrieved. The TMR Processor uses this data to log the state change into the system Sequence of Events (SOE) log. The user may configure each output to be included in the system SOE log. Full details of SOE are contained in Trusted Sequence of Events and Process Historian Package Product Description, publication [ICSTT-RM243](#).

Output Switch Structure

The Digital Output Module provides a TMR switch topology where the load is driven by a total of three fully monitored, fail-safe (6 element) switch channels, one physically resident on each FIU in the Module. Any single switch or entire slice failure is designed to leave two of the three fail-safe switch channels operational to power the load.

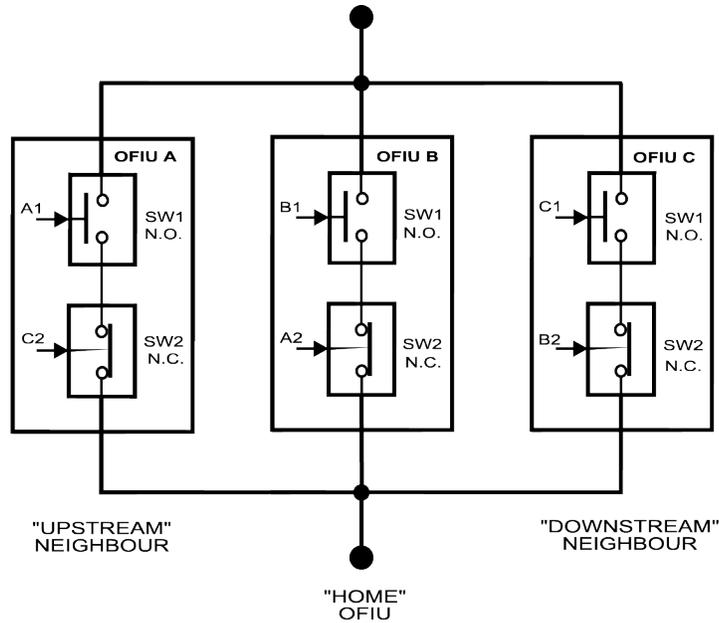


Figure 3: Output Switch Structure

The upper switches as shown in Figure 3 are denoted as N.O. (Normally Open), and are controlled by the FIU on which they are physically resident¹. The lower switches are depicted as N.C. (Normally Closed), and are controlled by the "upstream" neighboring FIU².



Note: In this context, N.O. is defined as being in the off state in the absence of control signal power, and similarly, N.C. is the on state in the absence of control signal power. These switches are constructed from enhancement mode MOSFETs and are both guaranteed to be off in the absence of Module power to create gate voltage signals to bias them on³ (unlike electromechanical relays for example).

The reason that the lower switches are specified to be on in the absence of control signal power is to allow two channels to power the load should an entire slice fail. Even if an entire slice fails, the surviving output circuits will carry the necessary control.

¹ Their "home" FIU.

² The home FIU, supplies an independent control signal for the "downstream" FIU FSS.

³ For an unfaulted transistor.

This is the structure of each FIU output:

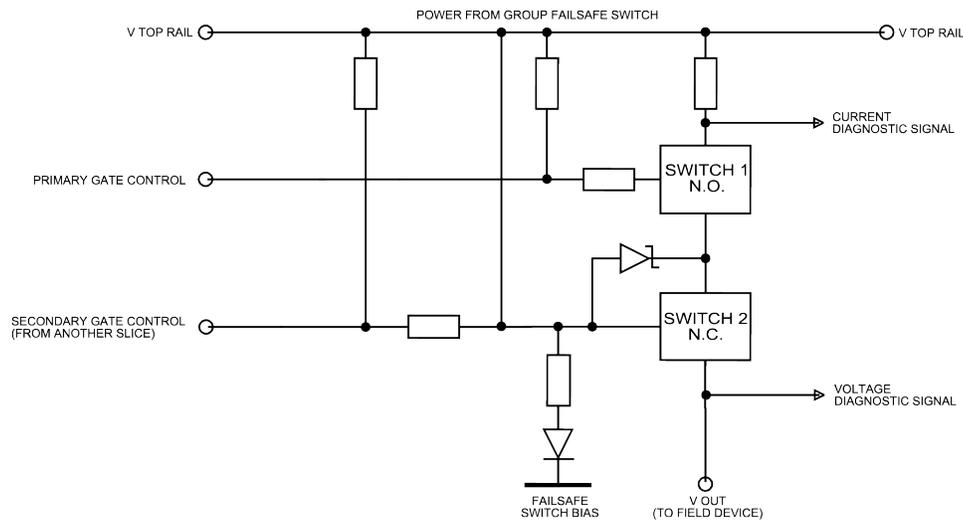


Figure 4: Simplified Switch Circuit Diagram

A resistor provides a means of continuously monitoring the switch current. A signal transistor is used to drive the gate of Switch 2. It provides Switch 2 with a negative gate voltage, to minimize its on resistance, and serves to hold Switch 2 on in the event that the secondary gate control loses power.

The Zener diode between the gate of Switch 2 and the source is only required to protect the gate from large voltage spikes on the drain that might capacitively couple through when Switch 1 and Switch 2 are in the off state.

The resistors in series with the gate of Switch 1 and the signal transistor serve to protect the drive logic in the event of a malicious switch failure. The pull-up resistors define the gate voltages in the absence of power.

Switch Diagnostics

During normal operation, Switch 1 and Switch 2 are maintained on. In this state, Switch 1 and Switch 2 exhibit a low resistance.

To determine the ability of the system to control the load via Switch 1 and Switch 2, their gate voltages are modulated, one at a time. As the gate voltages are modulated, the monitoring signals synchronously change in a predictable fashion. The local DSP analyses the relative amplitude and phase of these small AC signals, to determine the on resistance and threshold voltages of each switch.

The current to the load does not need to be completely interrupted in order to obtain a level of confidence in the ability of the transistors to turn off. For the TMR switch configuration in the on state, only one fail-safe switch at a time needs to be modulated, while the other two bear the load current.

Short Circuit Protection

Output channels are classified as protected under IEC 61131-2, specifically 'Protected Outputs Requirements'.

While energized, the channel output current is monitored to protect the channel switches from damage by a sustained overcurrent condition. Having detected a sustained overcurrent condition, a short-circuit fault state is latched and the output is de-energized.

While de-energized, the output may optionally be configured to detect short-circuit field faults (resistance less than 24 Ω) through System.INI file configuration. The detection of short-circuits while de-energized relies upon a partial energizing of the field circuit to determine the channel load resistance. The partial energizing of a field circuit is designed to constrain any change in field voltage or current to less than 2V or 100 mA, respectively.

A latched short-circuit fault state can be cleared by operating the system Fault Reset button or by transitioning the commanded channel state.

The output also includes a non-replaceable fusible link for absolute protection.

Group Fail-Safe Switches

To support safe operation, the Output Module is equipped with a series of switches that provide source power to a group of eight output channels, a Power Group. The Output Module Group Fail-Safe Switch (GFSS) is intended as a final control switch, which can de-energize any outputs that cannot be de-energized in the normal way. For safety, the presence of two or more faults within the Output Module will cause the Group Fail-Safe Switches to de-energize, resulting in all of the outputs in its group to de-energize.

There are three switches in parallel, which comprise the GFSS, one associated with each 'slice' of the power group. The GFSS' are controlled via a signal from one of the other two neighboring slices. This means that if one slice determines from the output states that an output is not in a de-energized state when it should be, then it can command its own GFSS and those of the other slices GFSS to de-energize. This results in two of the three elements of the GFSS structure to de-energize, leaving only one GFSS element energized. If two slices do the same thing, then the last GFSS output will de-energize. For example, this would occur if two or more output switch elements fail in a 'stuck-on' state such that the output cannot de-energize.

The GFSS control signal is generated by a charge pump driven from the comms clock to the slice power group. If the clock fails, then the GFSS bias collapses. This means that even if the ability of the slice to communicate with a power group is lost, the GFSS can still be de-energized by stopping the comms clock. If a slice fails, the watchdog on the HIU will time out and reset the slice, this will shut down the FIU power supply and the associated GFSS control signal will also de-energize.

Installation

Module Insertion and Removal



WARNING: The Module contains static sensitive parts. Static handling precautions must be observed. Specifically ensure that exposed connector pins are not touched. Under no circumstances should the Module housing be removed.

Before installation, visually inspect the Module for damage. Ensure that the Module housing appears undamaged and inspect the I/O connector at the back of the Module for bent pins. If the Module appears damaged or any pins are bent, do not install the Module. Do not try to straighten bent pins. Return the Module for replacement.

Ensure that the Module is of the correct type.

Record the Module type, revision and serial number of the Module before installation.

To install the Module:

1. Ensure that the field cable assembly is installed and correctly located.
2. If I/O Module keys are used, verify that all keys are installed in the correct positions and properly seated in their slots.
3. Release the ejector tabs on the Module using the release key. Ensure that the ejector tabs are fully open.
4. Holding the ejectors, carefully insert the Module into the intended slot.
5. Push the Module fully home by pressing on the top and bottom of the Module fascia.
6. Close the Module ejectors, ensuring that they click into their locked position.
- 7.

The Module should mount into the chassis with a minimum of resistance. If the Module does not mount easily, do not force it. Remove the Module and check it for bent or damaged pins. If the pins have not been damaged, try reinstalling the Module.

Cable Selection

I/O cables suitable for use with the Trusted TMR 24 Vdc Digital Output Module are detailed in the following Product Descriptions.

- Trusted I/O Companion Slot Cables Product Description, publication [ICSTT-RM311](#) (PD-TG200)
- Trusted I/O SmartSlot Cables Product Description, publication [ICSTT-RM313](#) (PD-TC500)

The Product Descriptions also detail the types of Field Termination Assembly (FTA) or Versatile Field Termination Assembly (VFTA) which may be used with this type of Module.

Custom length multi-core FTA cables are 0.5 mm² with a resistance of 40 Ω/km. For example, a 50 m cable will have 4 Ω loop impedance at 0.5 A, this equates to a 2 Vdc volt drop

Termination

Unused outputs should be commanded off in the application and wired through a 4K7 0.5 W resistor to zero volts.

Module Pinout Connections

Table 2 Field Connector Pinout

	C	B	A
1	SmartSlot Link C	SmartSlot Link B	SmartSlot Link A
2			
3	Chan 5 (+)	Pwr Group 1 (+)	Chan 1 (+)
4	Chan 6 (+)	Pwr Group 1 (+)	Chan 2 (+)
5	Pwr Group 1 Rtn	Pwr Group 1 (+)	Pwr Group 1 Rtn
6	Chan 7 (+)	Pwr Group 1 (+)	Chan 3 (+)
7	Chan 8 (+)	Pwr Group 1 (+)	Chan 4 (+)
8			
9	Chan 13 (+)	Pwr Group 2 (+)	Chan 9 (+)
10	Chan 14 (+)	Pwr Group 2 (+)	Chan 10 (+)
11	Pwr Group 2 Rtn	Pwr Group 2 (+)	Pwr Group 2 Rtn
12	Chan 15 (+)	Pwr Group 2 (+)	Chan 11 (+)
13	Chan 16 (+)	Pwr Group 2 (+)	Chan 12 (+)
14			
15	Chan 21 (+)	Pwr Group 3 (+)	Chan 17 (+)
16	Chan 22 (+)	Pwr Group 3 (+)	Chan 18 (+)
17	Pwr Group 3 Rtn	Pwr Group 3 (+)	Pwr Group 3 Rtn
18	Chan 23 (+)	Pwr Group 3 (+)	Chan 19 (+)
19	Chan 24 (+)	Pwr Group 3 (+)	Chan 20 (+)
20			
21	Chan 29 (+)	Pwr Group 4 (+)	Chan 25 (+)
22	Chan 30 (+)	Pwr Group 4 (+)	Chan 26 (+)
23	Pwr Group 4 Rtn	Pwr Group 4 (+)	Pwr Group 4 Rtn
24	Chan 31 (+)	Pwr Group 4 (+)	Chan 27 (+)
25	Chan 32 (+)	Pwr Group 4 (+)	Chan 28 (+)
26			
27	Chan 37 (+)	Pwr Group 5 (+)	Chan 33 (+)
28	Chan 38 (+)	Pwr Group 5 (+)	Chan 34 (+)
29	Pwr Group 5 Rtn	Pwr Group 5 (+)	Pwr Group 5 Rtn
30	Chan 39 (+)	Pwr Group 5 (+)	Chan 35 (+)
32	Chan 40 (+)	Pwr Group 5 (+)	Chan 36 (+)
32			

Trusted Module Polarization/Keying

All Trusted Modules have been Keyed to help prevent insertion into the wrong position within a Chassis. The polarization comprises two parts; the Module, and the associated field cable.

Each Module type has been keyed during manufacture. The organization responsible for the integration of the Trusted System must key the cable by removing the keying pieces from the cable so that they correspond with the bungs fitted to the associated Module before fitting.

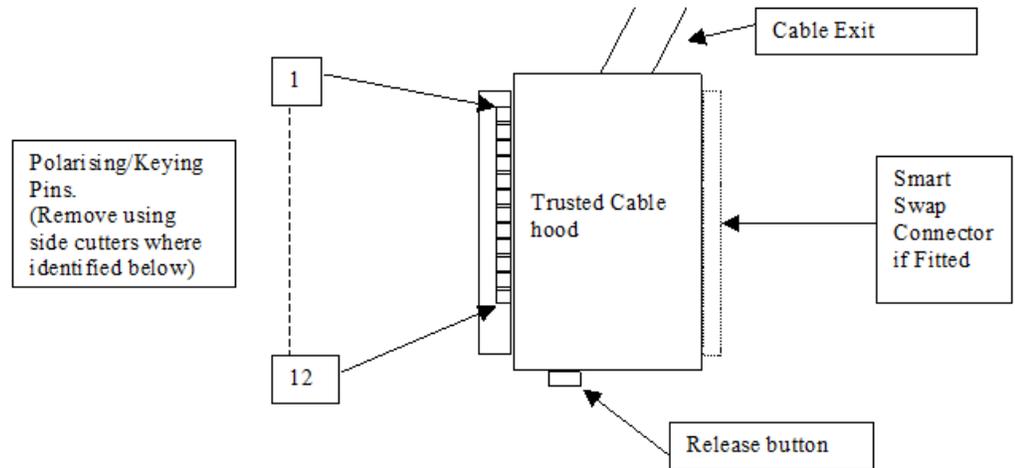


Figure 5: Module Polarization

For Cables with Companion slot installations, both keying strips must be polarized.

For this Module (T8451) remove keying pins 1, 5 and 6.

Application

Module Configuration

There is no configuration required to the physical Output Module. All configurable characteristics of the Module are performed using tools on the Engineering Workstation (EWS) and become part of the application or System.INI file that is loaded into the TMR Processor. The TMR Processor automatically configures the Output Module after applications are downloaded and during Active/Standby changeover.

The IEC 61131 TOOLSET provides the main interface to configure the Output Module. Details of the configuration tools and configuration sequence are provided Trusted Toolset Suite Product Description, publication [ICSTT-RM249](#) (PD-T8082). There are three procedures necessary to configure the Output Module:

1. Define the necessary I/O variables for the field output data and Module status data using the Dictionary Editor of the IEC 61131 TOOLSET.
2. Create an I/O Module definition in the I/O Connection Editor for each I/O Module. The I/O Module definition defines physical information, for example, Chassis and Slot location, and allows variables to be connected to the I/O channels of the Module.
3. Using the Trusted® System Configuration Manager, define custom LED indicator modes, per-channel default or fail-safe states, and other Module settings.

T8451 Complex Equipment Definition

The T8451 I/O Complex Equipment Definition includes eight I/O boards, referenced numerically by Rack number:

Table 3 Complex Equipment Definition

Rack	I/O Board	Description	Data Type	Direction	No. of Channels
1	DO	OEM Parameters	-	-	-
		Field Output Status	Boolean	Out	40
2	STATE	Field Output State	Integer	In	40
3	AI	Output voltage	Integer	In	40
4	CI	Output current	Integer	In	40
5	LINE_FLT	Line Fault Status	Boolean	In	40
6	DISCREP	Channel Discrepancy	Integer	In	3
7	HKEEPING	Housekeeping Registers	Integer	In	57
8	INFO	I/O Module Information	Integer	In	11

There are two OEM parameters included in the first rack (DO Board). These OEM parameters define the primary Module position; declaring the Module's chassis and slot location. There is no need to define the secondary Module

position within the IEC 61131 TOOLSET. Where systems may be required to start up with Modules in the secondary position as the Active Module, for example, the primary Module is not installed when the application is started, the secondary Module's position should be declared in the Module definition of the System Configuration Manager.

Table 4 OEM Parameters

OEM Parameter	Description	Notes
TICS_CHASSIS	The number of the Trusted Chassis where the primary I/O Module is installed	The Trusted Controller Chassis is 1, and Trusted Expander Chassis are 2 to 15.
TICS_SLOT	The slot number in the Chassis where the primary I/O Module is installed	The I/O Module slots in the Trusted Controller Chassis are numbered from 1 to 8. The I/O Module slots in the Trusted Expander Chassis are numbered from 1 to 12.

Rack 1: DO

This board provides the connection to the logical output control signal for each of the field outputs.

Table 5 Rack 1: DO descriptions

Channel	Description
1	Field output channel 1 logical state
2	Field output channel 2 logical state
40	Field output channel 40 logical state

The user application should set the output control signal to true (logic '1') to turn ON or energize an output, and false (logic '0') to turn OFF or de-energize an output.

Rack 2: STATE

This board provides the majority voted numerical output state. This indicates the operational status of the output channel and associated field connection.

Table 6 Rack 2: STATE bit Descriptions

Channel	Description
1	Field output channel 1 state
2	Field output channel 2 state
40	Field output channel 40 state

Table 7 Rack 2: State Output Descriptions

Channel	Description
7	Channel fault
6	Field fault (for example, field leakage to 0V or 24V)
5	Short circuit in field wiring or load
4	Output energized (ON)
3	Open circuit in field wiring or load
2	Output de-energized (OFF)
1	No field supply voltage
0	Unused

Rack 3: AI

The AI board returns the field loop voltage at the output.

Table 8 Rack 3: AI Descriptions

Channel	Description
1	Field output channel 1 voltage
2	Field output channel 2 voltage
40	Field output channel 40 voltage

The voltage is the median value taken from the triplicated Module. The voltage level is reported as an integer, with the units being 1/500V. This may be used directly, scaled arithmetically, or scaled using the IEC 61131 TOOLSET conversion tables.

To scale the value arithmetically, simply divide the returned 'integer' by 500 to return the voltage as either a REAL or INTEGER as required.

The IEC 61131 TOOLSET conversion tables may be used to convert the value to engineering units, in this case voltage. The full-scale range for this number format is decimal ± 64 , corresponding to the physical range -32000 to $+32000$.

Rack 4: CI

The CI board returns the field loop current at the output.

Table 9 Rack 4: CI Descriptions

Channel	Description
1	Field output channel 1 current
2	Field output channel 2 current
40	Field output channel 40 current

The current is the sum value taken from the triplicated Module. The current level is reported as an integer, with the units being 1/1000A. This may be used directly, scaled arithmetically or scaled using the IEC 61131 TOOLSET conversion tables.

To scale the value arithmetically, simply divide the returned 'integer' by 1000 to return the current as either a REAL or INTEGER as required.

The IEC 61131 TOOLSET conversion tables may be used to convert the value to engineering units, in this case current. The full-scale range for this number format is decimal ± 32 , corresponding to the physical range -32000 to $+32000$.

Rack 5: LINE_FLT

Table 10 Rack 5: LINE_FLT Descriptions

Channel	Description
1	Field output channel 1 line fault
2	Field output channel 2 line fault
40	Field output channel 40 line fault

The line fault input state is reported as true (logic ‘1’) for a line fault condition (open circuit, short circuit, and no field supply voltage). The logic state is the majority voted value.

Rack 6: DISCREP

Table 11 Rack 6: DISCREP bit Descriptions

Channel	Description
1	Discrepancy status outputs 1 to 16 (output 1 is LSB)
2	Discrepancy status outputs 17 to 32 (output 17 is LSB)
3	Discrepancy status outputs 33 to 40 (output 33 is LSB)

Each of the words reports the discrepancy status of 16 output channels. The corresponding bit within the word is set to ‘1’ when a discrepancy condition is detected on that output channel’s output state (Rack 2).

Rack 7: HKEEPING

Table 12 Rack 7: Housekeeping Descriptions

Channel	FCR	Description			
		Units (Full Scale Range)			
1	A	24V2 Output Voltage	-32768	32767	mV
2	B				
3	C				
4	A	Internal supply voltage (post regulator)	-32768	32767	mV
5	B				
6	C				
7	A	Internal supply current (post regulator)	-32768	32767	mA
8	B				
9	C				
10	A	Output voltage (post isolation)	-32768	32767	mV
11	B				
12	C				
13	A	24V1 Output Voltage	-32768	32767	mV
14	B				
15	C				
16	A	HIU Board Temperature (Note: Temperature, °C = input value / 256)	-32768	32767	-
17	B				
18	C				
19	A	Front Panel Load Current	-32768	32767	mA
20	B				
21	C				
22	A	SmartSlot Link Voltage	-32768	32767	mV
23	B				
24	C				
25	A	FIU Output Group 1 Field Supply Voltage	-32768	32767	mV
26	B				
27	C				
28	A	FIU Board Temperature, Output Group 1 (Note: Temperature, °C = input value / 256)	-32768	32767	-
29	B				
30	C				
31	A	FIU Output Group 2 Field Supply Voltage	-32768	32767	mV
32	B				
33	C				
34	A	FIU Board Temperature, Output Group 2	-32768	32767	-

Table 12 Rack 7: Housekeeping Descriptions

Channel	Description				
	FCR		Units (Full Scale Range)		
35	B	(Note: Temperature, °C = input value / 256)			
36	C				
37	A				
38	B	FIU Output Group 3 Field Supply Voltage	-32768	32767	mV
39	C				
40	A				
41	B	FIU Board Temperature, Output Group 3 (Note: Temperature, °C = input value / 256)	-32768	32767	-
42	C				
43	A				
44	B	FIU Output Group 4 Field Supply Voltage	-32768	32767	mV
45	C				
46	A				
47	B	FIU Board Temperature, Output Group 4 (Note: Temperature, °C = input value / 256)	-32768	32767	-
48	C				
49	A				
50	B	FIU Output Group 5 Field Supply Voltage	-32768	32767	mV
51	C				
52	A				
53	B	FIU Board Temperature, Output Group 5 (Note: Temperature, °C = input value / 256)	-32768	32767	-
54	C				
55	A				
56	B	Diagnostic error code			
57	C				

Each input within the housekeeping rack is reported as an integer. In general, the application engineer will not normally require these inputs. They are provided to aid fault finding and diagnosis and may be used for reporting and display purposes. If a slice is Fatal, then all reported housekeeping inputs are set to zero.

Rack 8: INFO

Table 13 Rack 8: INFO Descriptions

Channel	Description
1	Active Module chassis number
2	Active Module slot number
3	Active Module healthy
4	Active Module mode
5	Standby Module chassis number
6	Standby Module slot number
7	Standby Module healthy
8	Standby Module mode
9	FCR status
10	Primary Module is active
11	Active Module is simulated

The Active Module chassis and slot numbers indicate the position of the currently Active Module. These values will change to match the primary or secondary Module position, depending on their Active status, that is, Active/Standby changeover will "swap" the values for the Active Module chassis and slot number channels with those in the Standby Module chassis

and slot number channels. The chassis and slot numbers are set to zero if the Module is not present.

The Active and Standby Module healthy channel is returned as an integer, however only the least significant bit is used. A value of 0 indicates that a fault has been detected, a nonzero value indicates that the Module is healthy.

The Active and Standby Module Mode is an integer indicating the current operating mode of the associated Module. The value indicates the current internal operating mode of the Module.

Table 14 Rack 8: INFO bit Descriptions

Channel	Description
5	Shutdown
4	Maintain
3	Active
2	Standby
1	Configuration
0	Unknown, no Module present

The FCR Status channel reports the fault status of the Active and Standby Modules. The value is bit-packed as shown below, the least significant byte is used with the most significant 8 bits set to zero:

Table 15 Rack 8: FCR bit Descriptions

Bit							
7	6	5	4	3	2	1	0
Standby Module				Active Module			
Ejectors open	FCR C Healthy	FCR B Healthy	FCR A Healthy	Ejectors open	FCR C Healthy	FCR B Healthy	FCR A Healthy

The ‘Primary Module is active’ channel is set to nonzero if the primary Module is the current Active Module, that is, the Active Module is in the chassis and slot numbers defined within the OEM parameters.

The ‘Active Module is simulated’ channel is set to nonzero if the Active Module is being simulated, this will only be set if the Module is not present or the simulation enable has been set within the Module’s configuration in the System.INI file.

Each Boolean Output Variable can be configured for automatic Sequence of Events (SOE) logging. This applies to the Output Status and Line Fault Status variables. A Boolean variable is configured for SOE during the variable definition in the Data Dictionary Editor. To select SOE, press the Extended Button in the Boolean Variable Definition Dialog Box to open the Extended Definition Dialog. Then check the box for Sequence of Events to enable the variable for automatic SOE logging.

During operation, the Output Module automatically reports time-stamped change of state information for the output data. The TMR Processor automatically logs change of state for configured SOE variables into the

Sequence of Events Configuration

system SOE Log. The SOE Log can be monitored and retrieved using the SOE and Process Historian Package running on the EWS. This software package is described in Trusted Sequence of Events and Process Historian Package, publication [ICSTT-RM243](#) (PD-T8013)

System.INI File Configuration

There are many operating characteristics of the Output Module that can be customized for a particular application. The System Configuration Manager is a tool that allows the user to configure the specific operating characteristics for each Module. Descriptions of the items that may be configured for the Trusted 24 Vdc Digital Output Module T8451 are contained in Trusted Toolset Suite, publication [ICSTT-RM249](#) (PD-T8082).

Certain characteristics apply to the entire Module and are considered Module Configurable Items. Other characteristics apply to individual output channels and are considered Channel Configurable Items. There are specific default settings for each of the configurable items. If the default settings are appropriate for a given application, customization of the Module definition in the System Configuration Manager is not required.

In order for short circuit detection to function while outputs are de-energized, a short circuit detection template is required.

Operation

Front Panel

Status indicators on the Front Panel of the Module provide visual indications of the Module's operational status and field output status. Each indicator is a bicolor LED. At the top and bottom of each Module is an ejector lever that is used to remove the Module from the Chassis. Limit switches detect the open/closed position of the ejector levers. The ejector levers are normally latched closed when the Module is firmly seated into the Controller or Expander Chassis.

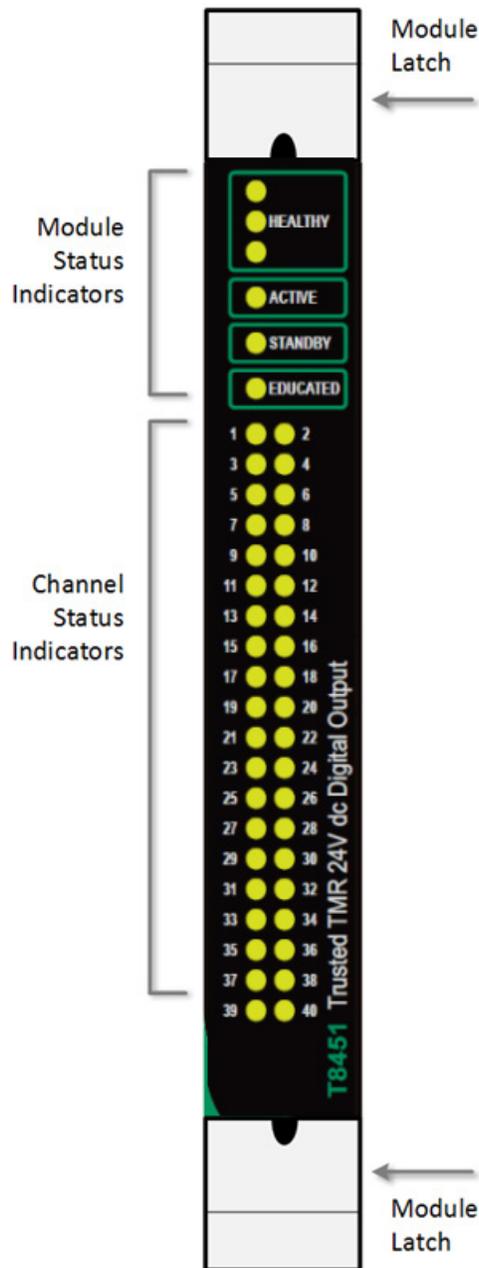


Figure 6: Module Front Panel

Module Status LEDs

There are six Module status indicators on the Module Front Panel: three Healthy, one Active, one Standby, and one Educated. The Healthy indicators are controlled directly by each Module slice. The Active, Standby, and Educated indicators are controlled by the FPU. The FPU receives data from each of the Module slices. It performs a 2003 vote on each data bit from the slices and sets the indicators accordingly.

The Module status indicator modes and their meanings are described as follows:

Indicator	State	Description
Healthy	Off	No power applied to the Module.
	Amber	Slice is in the startup state (momentary after installation or power-up).
	Green	Slice is healthy.
	Red - flashing	Fault present on the associated slice but the slice is still operational.
	Red (momentary) Red	On installation - power applied to the associated slice. The associated slice is in the fatal state. A critical fault has been detected and the slice disabled.
Active	Off	Module is not in the Active state.
	Green	Module is in the Active (or Maintain) state.
	Red - flashing	Module is in the shutdown state if the Standby LED is off.
	Red - flashing	Module is in the fatal state if the Standby LED is also flashing.
Standby	Off	Module is not in the Standby state.
	Green	Module is in the Standby state.
	Red - flashing	Module is in the fatal state. The Active LED is also flashing red.
Educated	Off	Module is not educated.
	Green	Module is educated.
	Green - flashing	Module is recognized by the Processor but education is not complete.
	Amber - Flashing	Active/Standby changeover in progress.

I/O Status Indicators

There are 40 output channel status indicators on the Module Front Panel, one for each field output. These indicators are controlled by the FPU. The FPU receives data from each of the Module slices. The FPU performs a 2003 vote on each data bit from the slices and sets the indicators accordingly.

The output status indicator mode is dependent upon the numerical state of the output channel. Each output state can be defined to have a particular indicator mode: off, green, red, flashing green, or flashing red.

The configurable indicator modes allow users to customize the output status indications to suit individual application requirements. Without customization, the default indicator modes are suitable for line-monitored digital output devices as described in this table:

INDICATOR STATE	DESCRIPTION
Off	Output is Off.
Green	Output is On.
Green - flashing	No Load, output open circuit.
Red	Field short circuit, output over current protection triggered and output channel is latched off.
Red - flashing	Channel fault, or no field supply voltage.



Tip: The LEDs indicating channel status may be configured to suit user requirements by implementing the procedure for configuring the System.INI file detailed in Trusted Toolset Suite Product Description, publication [ICSTT-RM249](#) (PD-T8082).

Fault Finding and Maintenance

Fault Reporting

Output Module faults are reported to the user through visual indicators on the Front Panel of the Module and through status variables, which may be automatically monitored in the application programs and external system communications interfaces. There are generally two types of faults that must be remedied by the user: external wiring and Module faults. External wiring faults require corrective action in the field to repair the fault condition. Module faults require replacement of the Output Module.

Field Wiring Faults

By measuring the output channel voltage and current, the Module automatically detects field wiring and load faults. When a field signal fails open circuit, short circuit or there is no field supply voltage connected, the output status indicator will display the configured LED mode, the corresponding output state will be reported and the line fault status for that channel will be set to '1'. All other output channels will be unaffected, except in the case of common cause wiring and supply voltage faults in the field.

The field output voltage and current variables can be monitored to determine the actual operating conditions of each output channel. This additional information assists the user in determining the specific type of wiring fault.

Once the specific field wiring fault has been identified and corrected, the output status variables and output status indicator will display the normal on/off status of the field device.

Module Faults

Extensive diagnostics provide the automatic detection of Module faults. The TMR architecture of the Output Module and the diagnostics performed verify the validity of all critical circuits. Using the TMR architecture provides a Fault Tolerant method to withstand the first fault occurrence on the Module and continue normal output controls without interruption in the system or process. Faults are reported to the user through the Healthy status indicators on the Front Panel of the Module and through the INFO and HKEEPING variables. Under normal operations all three Healthy Indicators are green. When a fault occurs, one of the Healthy Indicators will be flashing red. It is recommended that this condition is investigated and if the fault is within the Module, it should be replaced.

Module replacement activities depend on the type of spare Module configuration chosen when the system was configured and installed. The Module may be configured with a Dedicated Standby Slot or with a SmartSlot for a spare replacement Module.

Companion Slot

For a Companion Slot configuration, two adjacent slots in a Trusted Chassis are configured for the same Output Module function. One slot is the primary slot and the other a unique secondary (or spare) slot. The two slots are joined at the rear of the Trusted Chassis with a double-wide I/O Interface Cable that connects both slots to common field wiring terminations. During normal operations, the primary slot contains the Active Module as indicated by the Active indicator on the Front Panel of the Module. The secondary slot is available for a spare Module that will normally be the Standby Module as indicated by the Standby indicator on the Front Panel of the Module.

Depending on the installation, a hot-spare Module may already be installed, or a Module blank will be installed in the Standby slot. If a hot-spare Module is already installed, transfer to the Standby Module occurs automatically when a Module fault is detected in the Active Module. If a hot-spare is not installed, the system continues operating from the Active Module until a spare Module is installed.

SmartSlot

For a SmartSlot configuration, the secondary slot is not unique to each primary slot. Instead, a single secondary slot is shared among many primary slots. This technique provides the highest density of Modules to be fitted in a given physical space. At the rear of the Trusted Chassis, a single-wide I/O Cable connects the secondary slot directly to the I/O Cable connected to the failed primary Module. With a spare Module installed in the SmartSlot and the SmartSlot I/O Cable connected to the failed primary Module, the SmartSlot can be used to replace the failed primary Module.

Output Module Slot Jumper cable TC-308-02

SmartSlot between Chassis can be performed if the Chassis are version 2 (or higher). These Chassis have the connector fitted to enable connection of a TC-006 that verifies that the 0 Volt of each Chassis is at the same potential.

Cold Start

If an I/O Module has shut down (due, for example, to two existing faults), the three Healthy LEDs will be red, the Active and Standby LEDs will be flashing red and the Educated LED will be flashing amber. The I/O functions provided by this Module will have been lost if a hot swap partner has not taken over control. The Module can only be restarted by removing it from its slot and reinserting it.

If an I/O Module is inserted into a functional system slot which previously had no Active Module (for example, removing and reinserting as above), then the Processor will educate the Module once it has booted. Once educated, the Educated LED will be steady green and the Active LED will be red flashing.

Input Modules will now be reading and reporting their inputs. Output Modules have not yet energized their outputs. To activate outputs and to set the Module's Active LED and the Processor's System Healthy LED steady green, press the Processor Reset push button.

Transfer between Active and Standby Modules

The TMR Processor is responsible for managing a pair of I/O Modules through an Active/Standby changeover. The following rules apply to Active/Standby changeovers, though the TMR Processor and not the I/O Module enforces them:

- The user must define the primary, and optionally the secondary, I/O Module location for each I/O Module pair. Each primary Module location must be unique and is defined as part of the complex equipment definition within the IEC 61131 TOOLSET. Secondary Module locations can be unique or shared between multiple secondary Modules and are defined within the Module's section within the System.INI file. The system will automatically determine the secondary Module position if the primary Module is installed and is operable.
- On initial startup, if the primary Module is installed, it will become the Active Module by default. If the secondary Module has been defined within the System.INI file and no primary Module is present, and if the secondary Module location is unique, the secondary Module will become the Active Module by default. If the secondary Module is installed with no primary Module present, and the secondary Module location is not unique (as in a SmartSlot configuration), then NO Module for that Module pair will become Active.
- In order for a Module to become the Active Module, the TMR Processor will verify that the Module is the correct I/O Module type and that both Module Removal switches are closed. At this point, the I/O Module is configured and eventually placed in the Active state.
- A Module in the Active state should never be removed.
- When a fault occurs on the Active Module, the TMR Processor will be informed. Once it becomes aware of the fault, the TMR Processor will attempt an Active/Standby changeover.
- An Active/Standby changeover starts with the TMR Processor checking to see if a Standby I/O Module is installed. If no Standby I/O Module is available, the TMR Processor will continue to use the Active Module and will continue to check for an available Standby I/O Module. Once a Standby Module is found, the TMR Processor will verify that the I/O Module is of the correct type, that both Module Removal switches are closed, and that the I/O Module is a part of the correct Module pair by using the SmartSlot link. At this point, the TMR Processor will configure the Standby I/O Module with the same configuration information as the currently Active I/O Module and place the Standby I/O Module into the Standby state. The Active Module is then placed in the Maintain state (which suspends field loop testing), and any Module-specific changeover data is transferred. The educated light flashes amber before the Active/Standby changeover takes place, to indicate transfer of dynamic change over data (COD). The previous Standby Module then becomes the Active Module and the original Module becomes Standby. If the currently Active Module does not

successfully complete the self-tests, the TMR Processor will revert it to the Standby state, and the Module in the Maintain state will revert to the Active state.

- When both Module Removal switches are opened on an Active Module, regardless of the Module fault status, the TMR Processor will treat it as a request to perform an Active/Standby changeover.

Under normal conditions, an Active/Standby changeover will only occur if the new Active Module is fault free. Under some circumstances, it is desirable to be able to force a changeover to a known faulted Module. This can be accomplished by opening the Module Removal switches on the currently Active Module and pressing the reset push button on the TMR Processor. This will force the changeover to proceed even if the new Active Module is not fault free.

Specifications

Specifications

This table lists the module specifications:

Item	Description
Backplane (IMB) Supply	
Voltage	20V DC to 32V DC
Power	27 W
Field Supply	
Voltage	18V DC to 32 V DC
Maximum Current	40 A limited to 8 A per power group ($T_A = 50\text{ }^\circ\text{C max}$) 30 A limited to 6 A per power group ($T_A = 60\text{ }^\circ\text{C max}$)
Power Dissipation	
Field Supply at maximum power group current.	128 W ($T_A = 50\text{ }^\circ\text{C max}$) 96 W ($T_A = 60\text{ }^\circ\text{C max}$)
System Supply	27 W
Module Location	T8100, T8300 I/O Module Slot
Isolation	
Power Group to Power Group	50V Reinforced (continuous) ⁴ [Type tested at 1411V DC for 60 s].
Field Common	50V Reinforced (continuous) ⁵ 250V Basic (fault) ⁶ [Type tested at 2436V DC for 60 s].
Channel to Channel	None
Fusing	Not user serviceable
Number of Outputs	40
Number of Power Groups	5 Each Power Group comprises 8 channels
Output	
Output On State resistance	1.6 Ω
Maximum Current Rating (Continuous)	2 A per channel
Minimum On State Load Current	50 mA
Current Measurement Range	0 A to 2.7 A $\pm 5\%$ / $\pm 5\text{ mA}$ ⁷
Voltage Measurement Range	0V DC to +30V DC $\pm 2\%$ DC
Maximum Withstanding	-1V DC to +40V DC
Channel to Channel Crosstalk	< 1%
Maximum Load Capacitance	3000 μF
Output Short Circuit Protection	Electronic latching

⁴ 50V rms Secondary circuit derived from Mains, OVC II up to 300V.

⁵ 50V rms Secondary circuit derived from Mains, OVC II up to 300V.

⁶ 250V rms Mains circuit, OVC II up to 300V. Exposure to voltages at these levels shall be temporally constrained consistent with the system MTTR.

⁷ Tolerance is $\pm 5\text{ mA}$ up to 1.8 A, thereafter is $\pm 5\%$.

Item	Description
Sequence of Events	
Event Resolution (LSB)	1 ms
Time stamp Accuracy	±10 ms
Operating Temperature	0 °C to +60 °C (+32 °F to +140 °F)
Storage Temperature	-25 °C to +70 °C (-13 °F to +158 °F)
Relative Humidity - Operating and Storage	10% - 95%, noncondensing
Environmental Specifications	Refer to Document ICSTT-ID003
Dimensions	
Height	266 mm (10.5 in)
Width	31 mm (1.2 in)
Depth	303 mm (12.0 in)
Weight	1.3 kg (2.7 lb)

History of changes

This appendix contains the new or updated information for each revision of this publication. These lists include substantive updates only and are not intended to reflect all changes. Translated versions are not always available for each revision.

PD-T8451 Issue 15, August 2021

Change

Updated link for TechConnectsm support contract access level and features
Removed instruction for using By Product when searching knowledge base
Updated branding

PD-T8451 Issue 14, January 2019

Change

Updated Specifications section and main text for consistency
Updated Front Panel section to match updated product design
Added Rockwell Automation publication numbers
Added trademark statement

PD-T8451 Issue 13, August 2015

Change

Rebranded and reformatted with correction to Relative Humidity Range, and Operating Temperature in the Specification section
Corrected typographical errors

PD-T8451 Issue 12, April 2010

Change

Minor change to Rack 7 table

PD-T8451 Issue 11, November 2007

Change

Updated state descriptions

PD-T8451 Issue 10, December 2006

Change

Updated weight and dims

PD-T8451 Issue 9, August 2006

Change

Updated channel states

PD-T8451 Issue 8, July 2005

Change

Reformatted and edited text

Rockwell Automation support

Use these resources to access support information.

Technical Support Center	Find help with how-to videos, FAQs, chat, user forums, and product notification updates.	rok.auto/support
Knowledgebase	Access Knowledgebase articles.	rok.auto/knowledgebase
Local Technical Support Phone Numbers	Locate the telephone number for your country.	rok.auto/phonesupport
Literature Library	Find installation instructions, manuals, brochures, and technical data publications.	rok.auto/literature
Product Compatibility and Download Center (PCDC)	Get help determining how products interact, check features and capabilities, and find associated firmware.	rok.auto/pcdc

Documentation feedback

Your comments help us serve your documentation needs better. If you have any suggestions on how to improve our content, complete the form at rok.auto/docfeedback.

Waste Electrical and Electronic Equipment (WEEE)



At the end of life, this equipment should be collected separately from any unsorted municipal waste.

Rockwell Automation maintains current product environmental information on its website at rok.auto/pec.

Allen-Bradley, expanding human possibility, Logix, Rockwell Automation, and Rockwell Software are trademarks of Rockwell Automation, Inc.

EtherNet/IP is a trademark of ODVA, Inc.

Trademarks not belonging to Rockwell Automation are property of their respective companies.

Rockwell Otomasyon Ticaret A.Ş. Kar Plaza İş Merkezi E Blok Kat:6 34752, İçerenköy, İstanbul, Tel: +90 (216) 5698400 EEE Yönetmeliğine Uygundur

Connect with us.    

rockwellautomation.com ————— expanding **human possibility**[™]

AMERICAS: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444

EUROPE/MIDDLE EAST/AFRICA: Rockwell Automation NV, Pegasus Park, De Kleetlaan 12a, 1831 Diegem, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640

ASIA PACIFIC: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846