

Field Device Controller 280 (FDC280)



The Field Device Controller 280 is a distributed, optionally fault-tolerant, field-mounted controller that performs process control and alarming functions according to a user-defined control strategy, as well as providing direct field device integration without the need for additional Fieldbus Modules (FBMs).

OVERVIEW

The Field Device Controller 280 (FDC280) is a distributed, optionally fault-tolerant, field-mounted controller module, whose primary purpose is for device integration, including interfacing field devices, accessing data in those devices for display, historization, and performing control tasks, including interfacing Ethernet and Serial field devices. The FDC280 performs regulatory, logic, timing, and sequential control internally. It also performs alarm detection and notification.

The FDC280 runs a dual-core CPU to provide two computational environments for the FDC280 - Core 1 (Control Core) for the FDC280's control software and Foxboro Evo Control Network communications software, and Core 2 (I/O Core) for running additional features, in this case, the device integration software.


The FDC280 communicates directly with field devices which support the protocols listed in the following PSSes:

- ▶ PSS 31S-3FDCMBDV, *Modbus Master TCP Driver for Field Device Controller 280*

- ▶ PSS 31S-3FDCMBRT, *Modbus Master RTU Serial Driver for Field Device Controller 280*

The FDC280 connects to the Foxboro Evo Control Network via standard fiber optic or copper 100 Mbps Ethernet cables from network adapters installed on its baseplate (shown in Figure 1).

It requires a host workstation with Foxboro Evo Control Core Services software v9.3 or later. The FDC280 is certified ISASecure™ EDSA Level 1. A system with the FDC280 and this software is called a Foxboro Evo Process Automation System.

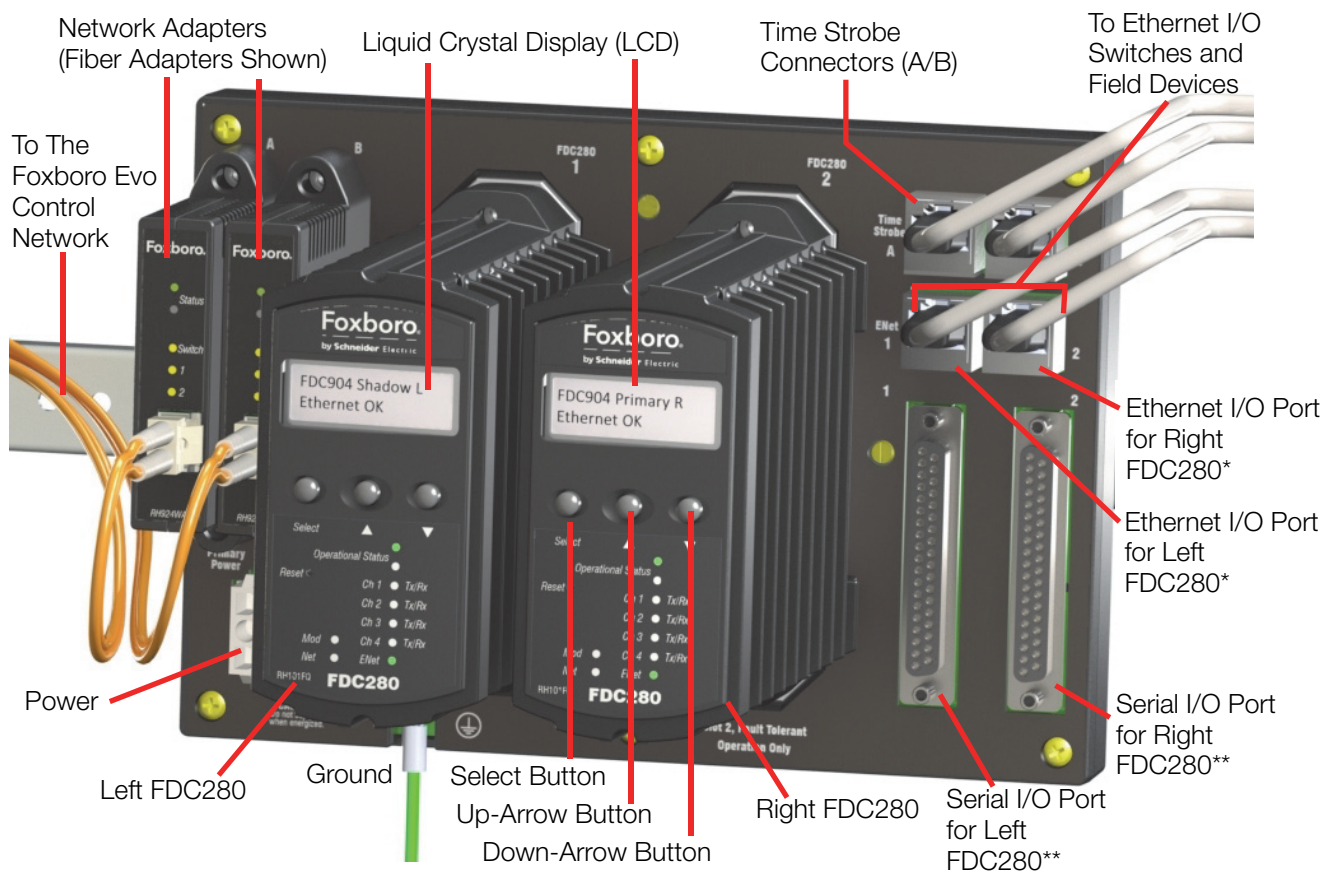

* These Ethernet ports enable communications via the customer-supplied dedicated network to the field devices.

** These Serial ports enable communications via the customer-supplied dedicated network to the field devices.

Figure 1. Fault-Tolerant FDC280 Module Pair Mounted on 2-Position FDC280 Baseplate

The fault-tolerant version of the FDC280 consists of two controller modules. These modules are installed in adjacent FDC280 slots in dedicated baseplates for high speed communication between the modules.

The FDC280 baseplate also includes the following types of connectors:

- ▶ Two Cat 5 RJ-45 connectors for Time Strobe connections - these allow time strobe cables to connect directly to the baseplate without the need for Time Strobe Adapters.
- ▶ Two 10/100 Mbps or 1 Gbps copper Cat 5e or Cat 6 Ethernet RJ-45 connectors for Ethernet connections to supported field devices (via customer-supplied Ethernet switches).
- ▶ Two 37-pin D-type connectors, each of which supports four Serial ports (to field devices via supported termination assemblies) - Use the Compact Type 5 cables in Table 1 on page 18 to connect the FDC280's baseplate to the termination assemblies.

Unlike the Field Control Processor 280 (FCP280), the FDC280 does not support the PIO bus, as it is designed primarily for field device integration using the Ethernet and Serial protocols.

To estimate the FDC280's processor load, refer to *Field Device Controller 280 (FDC280) Sizing Guidelines and Excel Workbook* (B0700GS).

For a description of the FDC280 baseplate, refer to *Standard 200 Series Baseplates* (PSS 31H-2SBASEPLT).

FDC280 ETHERNET NETWORK CONFIGURATIONS

The FDC280 supports various Ethernet network configurations to connect with supported field devices. The FDC280 can connect directly to field devices with Ethernet I/O, or to field devices with Serial I/O via a protocol-specific gateway which performs the Ethernet-to-Serial I/O bridging.

These configurations are discussed in the following sections.

Simplex FDC280 to Ethernet Field Devices Configuration

A simplex, non-fault-tolerant FDC280 connects to Ethernet field devices as shown in Figure 2.

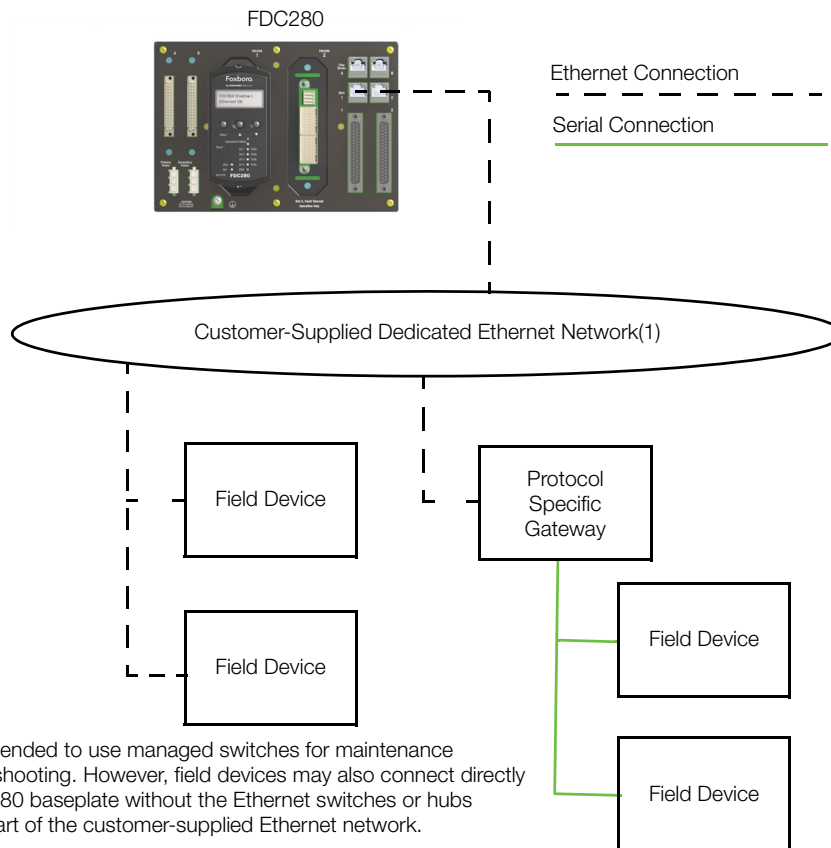


Figure 2. Non-Fault-Tolerant FDC280 to Ethernet Field Devices (Simplified)

A simplex connection, such as this configuration, saves on cabling since it does not require a redundant connection to the field device's Ethernet I/O network from the FDC280.

Fault-Tolerant FDC280 to Ethernet Field Devices over Separate Networks Configuration

Fault-Tolerant FDC280s can connect to Ethernet field devices over separate networks as shown in Figure 3.


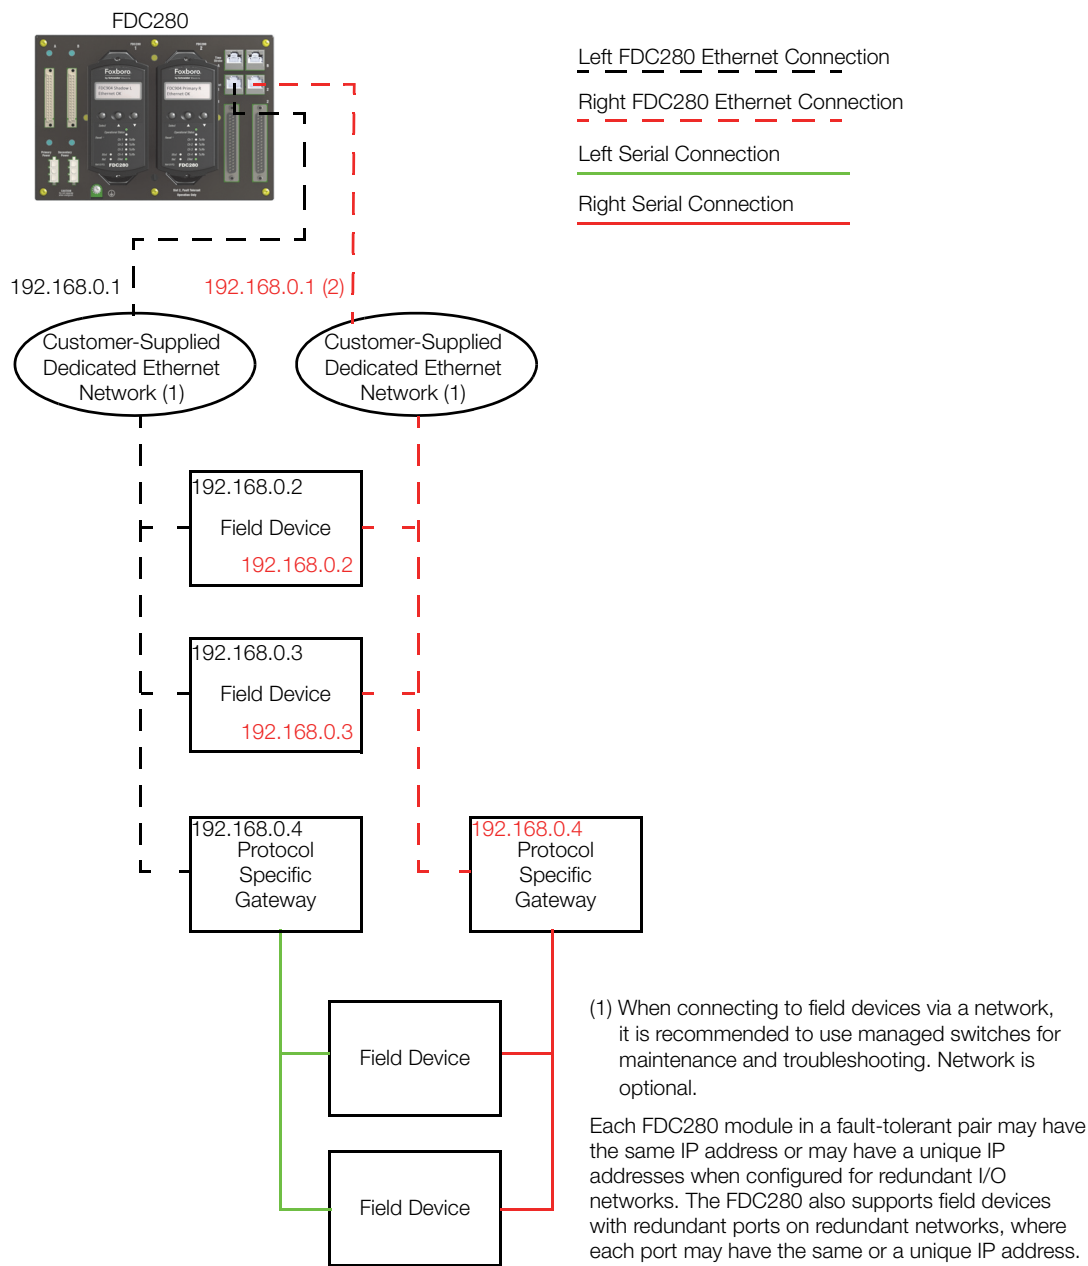


Figure 3. Fault-Tolerant FDC280s to Ethernet Field Devices in Separate Networks

Fault-Tolerant FDC280 to Ethernet Field Devices over Common Networks Configuration

Fault-Tolerant FDC280s can connect to Ethernet field devices over a common network as shown in Figure 4. In cases where field devices do not need

separate I/O networks, a common I/O network can be used. A common network allows for a fault-tolerant FDC280 to connect to single-ported field devices.

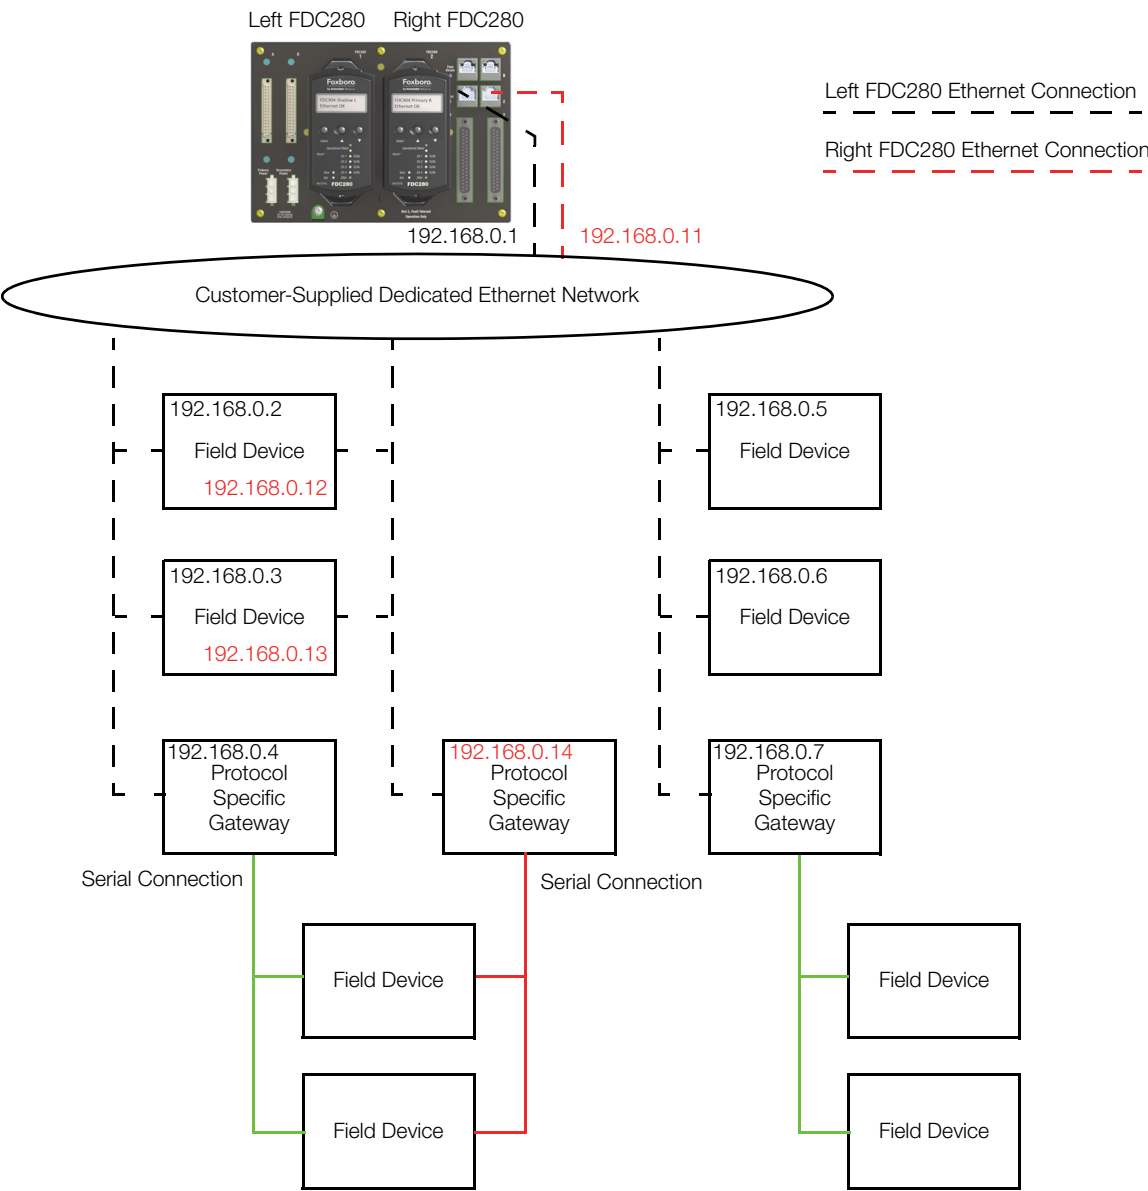

NOTE: For example IP addresses, use subnet 192.168.0.x with subnet mask 255.255.255.0.
(1) It is recommended to use managed switches for maintenance and troubleshooting. However, field devices may also connect directly to the FDC280 baseplate without the Ethernet switches or hubs which are part of the customer-supplied Ethernet network.

Figure 4. Fault-Tolerant FDC280s to Ethernet Field Devices in Common Network

FDC280 SERIAL NETWORK CONFIGURATIONS

The FDC280 has four Serial ports - each port can be individually configured for RS-232, RS-422, or RS-485. In non-redundant configurations, a simplex FDC280 is used for interfacing single ported field devices. In redundant configurations, the fault tolerant FDC280s (Left/Right) can both interface dual-porting and single-porting field devices (RS-232 via a Y cable). The FDC280 supports up to 128 RS-485 field devices distributed over its four ports. On a port configured for RS-485 protocol, the maximum number of devices supported is 32.

Simplex FDC280 to Serial Field Devices Configuration

A simplex, non-fault-tolerant FDC280 connects to Serial field devices via supported termination assemblies as shown in Figure 5.

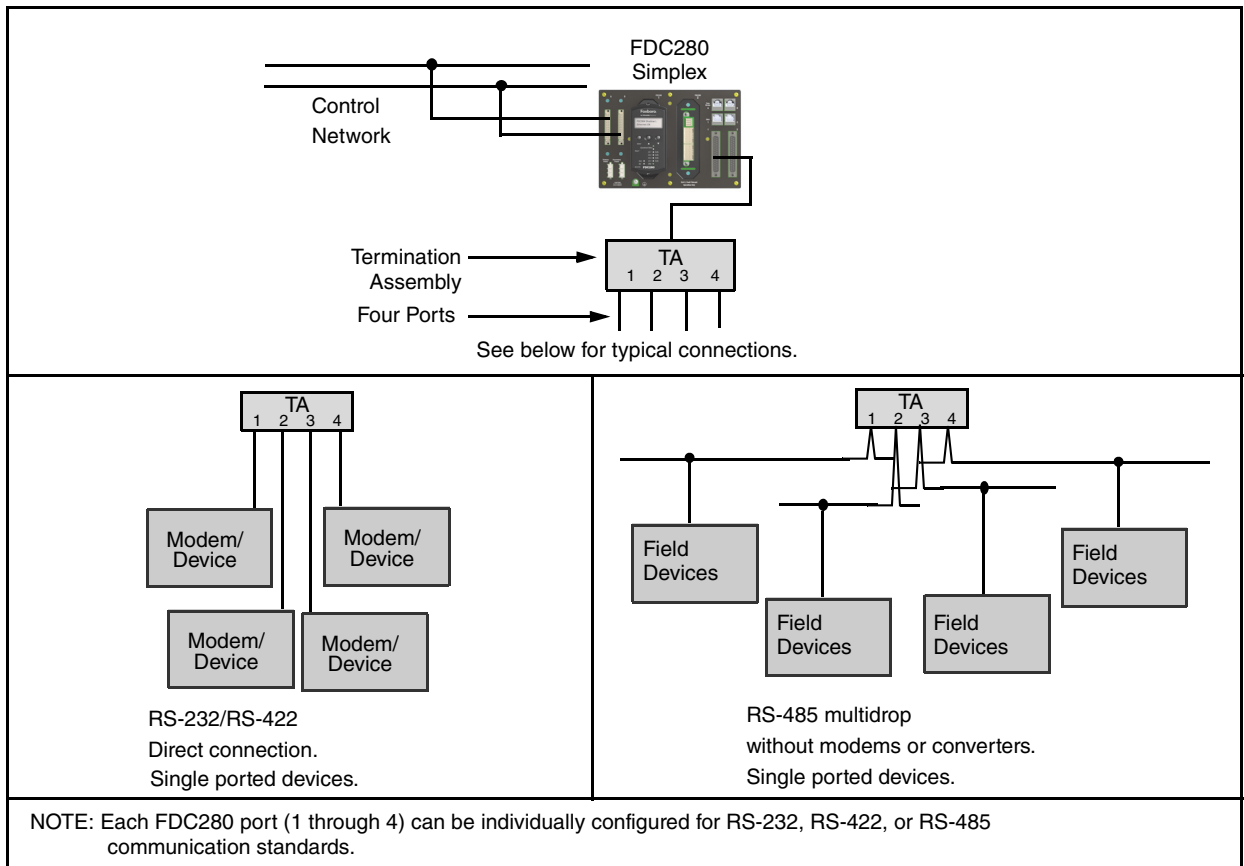


Figure 5. FDC280 Simplex in Typical Serial Network Configurations

Fault-Tolerant FDC280 to Serial Field Devices Configuration

Fault-tolerant FDC280s can connect to Serial field devices via supported termination assemblies as shown in Figure 6 and Figure 7.



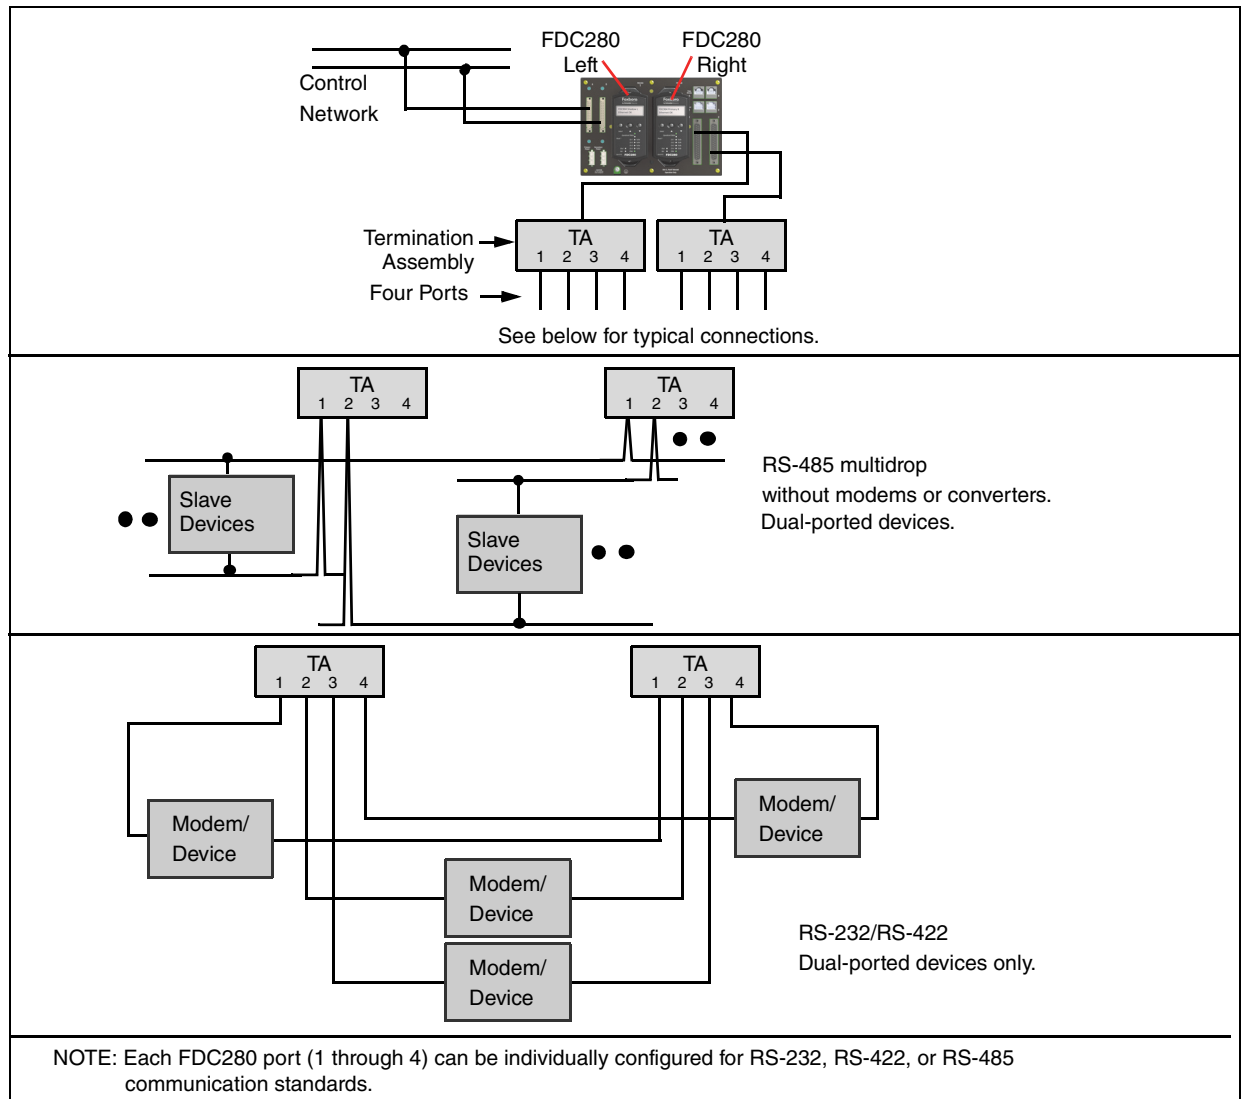


Figure 6. Fault-Tolerant FDC280 to Dual-Ported Serial Devices in Typical Network Configurations

RS-232 Configuration

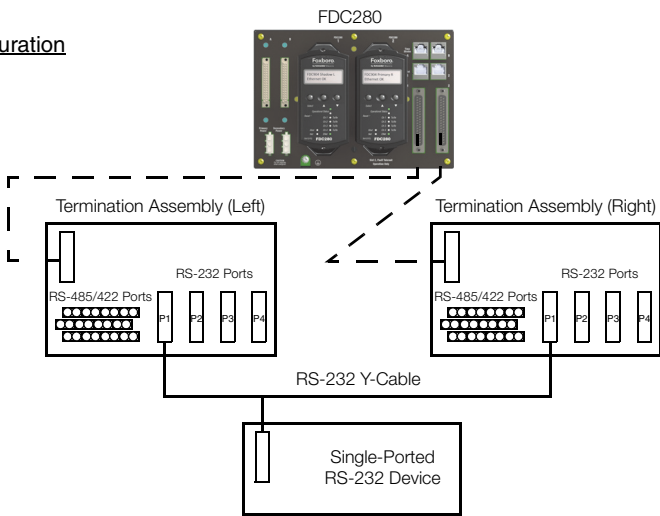

RS-485 2-Wire Configuration

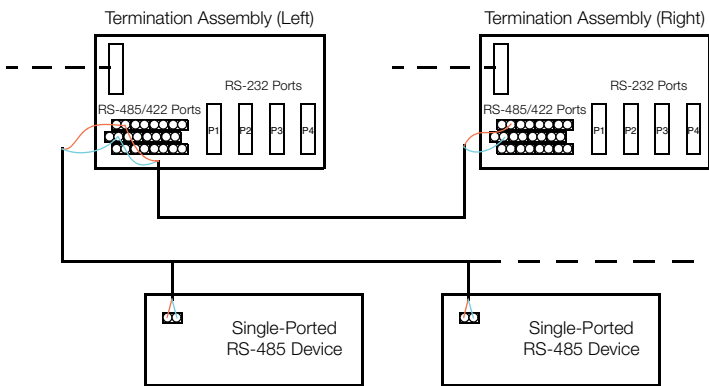

RS-422 4-Wire Configuration

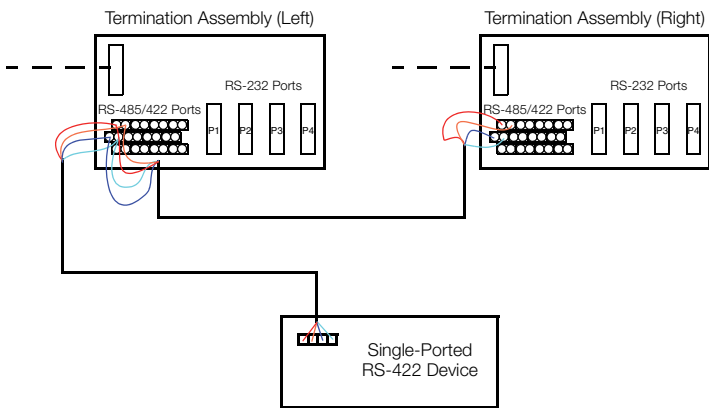


Figure 7. Fault-Tolerant FDC280 to Single-Ported Serial Devices in Typical Configurations

FEATURES

- ▶ Supports up to 256 field devices, up to 8,000 I/O points, and up to 8,252 total blocks. (For sizing guidelines, including examples of valid block count combinations, refer to *Field Device Controller 280 (FDC280) Sizing Guidelines and Excel Workbook* (B0700GS).)
- ▶ Supports up to 128 Serial field devices with a maximum of 32 devices per each Serial port.
- ▶ Supports up to 32 instances of concurrent drivers including:
 - Multiple instances of the same driver
 - Multiple versions of the same driver
 - Multiple protocols
 - One instance of the Diagnostic Driver
- ▶ Supports diagnosing communication issues with Ethernet or Serial devices with no physical disruption to device interfaces with a Diagnostic Driver. The driver can be configured to send all the messages exchanged with any device to a diagnostic application running on a workstation connected to the I/O Ethernet network.
- ▶ Support for multiple types of field devices using specific drivers run on the FDC280
- ▶ Performs regulatory, logic, timing, and sequential control internally.
- ▶ Performs data acquisition and alarm detection and notification.
- ▶ Supports self-hosting mode, which allows the FDC280 to boot itself with a valid control database even without its host workstation being on-line.
- ▶ Offers unique, patented, fault-tolerant operation using two control modules for communications over the Foxboro Evo Control Network. The FDC280 always supports redundant communications to the customer-supplied network which connects to the field device. However, if the field device is single-ported, the redundant cabling can only be extended to the switch if the device is Ethernet or the TA if the device is Serial. Refer to Figure 4 and Figure 7.
- ▶ Provides separate Image Update capabilities for Major (typically new features and functions) and Minor software updates.
 - The Major Image Update process is to introduce significant new functionality that is not compatible with an online upgrade approach.
 - The Minor Image Update process for updates which can be performed with no bump to the process other than a module failover.
- ▶ Liquid Crystal Display (LCD) displays letterbug and real-time roles and statuses.
- ▶ Uses soft letterbugs configurable via the buttons on the FDC280 faceplate.
- ▶ Connects to The Foxboro Evo Control Network via standard fiber optic or copper 100 Mbps Ethernet cables.
- ▶ Uses a rugged, die cast aluminum housing for mounting in a non-vented field enclosure.
- ▶ Can operate in Class G3 harsh environments.
- ▶ CE certified for field mounting in enclosures.
- ▶ Uses versatile control algorithms to provide control capabilities for a broad range of process applications.
- ▶ Supports time synchronization using optional external time from GPS satellites.

FIBER AND COPPER NETWORK ADAPTERS

FDC280 modules connect to a pair of fiber or copper adapters (see Figure 8) which each connect to one Ethernet switch in the control network. The FDC280 baseplate passes inbound traffic from either of the two switches to both FDC280s, and pass outbound

traffic from the primary FDC280 module to either switch.

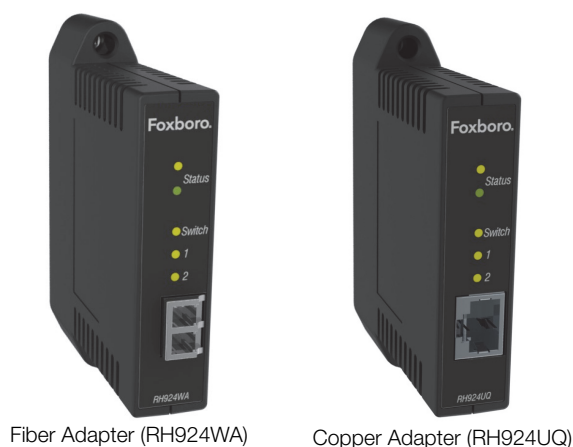


Figure 8. Fiber Optic and Copper Network Adapters

The fiber or copper adapters mount on the FDC280 baseplate as shown in Figure 1 on page 2. They receive their power from the baseplate.

REMOTE MOUNTING

The FDC280 simplifies the Foxboro Evo System architecture when integrating field devices. It requires housing (via field enclosures), host workstations with the Control Core Services v9.3 or later, and Ethernet switches for communication via the Control Network architecture, described in PSS 31H-7NWEQUIP, as well as customer-supplied switches for field device communication.

The field-mounted FDC280 is an integral part of the highly-distributed control network where controllers are installed in a central location, and then connected remotely to their I/O and the actual equipment being controlled via a customer-supplied dedicated network. Coordination between process units takes place via the Foxboro Evo Control Network, a fiber optic 100 Mbps Ethernet network. Coordination between the FDC280 and its I/O field devices takes place over a customer-supplied dedicated copper 10/100 Mbps or 1 Gbps Ethernet network.

The FDC280 is packaged in a rugged, die cast aluminum housing that does not require venting due to its efficient design. The FDC280 and its network adapters are CE certified, and can be mounted without expensive special cabinets to help prevent electronic emissions. The FDC280, network adapters, and baseplate can be mounted in Class G3 harsh environments.

ENHANCED RELIABILITY

Fault-Tolerance over the Foxboro Evo Control Network

When two FDC280s are installed on the same FDC280 baseplate and have two Ethernet connections to the Foxboro Evo Control Network, they undergo a “marriage” operation which allows them to provide a continuous connection to the control network to allow fault-tolerant operation to be possible. This is a unique and patented operation which improves availability over the use of a single FDC280.

Both modules receive and process information simultaneously, and faults are detected by the modules themselves. One of the significant methods of fault detection is comparison of control network communication messages at the module external interfaces. Messages for the control network only (not for the field devices) leave the FDC280 when both FDC280s agree on the message being sent (bit for bit match).

NOTE

Communications between the FDC280s and the field devices are considered redundant, not fault-tolerant, as fault-tolerant types of checks are not performed over the two Ethernet connections that the FDC280s use to communicate to the customer-configured field device network.

Upon identifying a detected fault, self-diagnostics are

run by both FDC280s to determine which module is not working. The working module then assumes control without affecting normal system operations. This is called “fault-tolerancy” although it is not the only fault-tolerant operation that the FDC280 supports.

Core 1 CPU Fault-Tolerance

The Core 1 CPUs in a fault-tolerant pair of FDC280s also operate in a fault-tolerant fashion, with a Primary and Shadow Core 1. If the FDC280 detects any issues with the operation of the Primary Core 1, the Primary and Shadow FDC280s swap roles.

Core 2 CPU Redundancy

The Core 2 CPUs in the Primary and Shadow FDC280s operate in a redundant manner. Both Primary and Shadow Core 2 CPUs evaluate and independently publish their diagnostic statuses and device connection statuses (of enabled devices). If the Primary Core 2 detects any fault on its own side, it compares its statuses versus the statuses reported by the Shadow Core 2. If the Shadow Core 2 is seen to have a better connectivity to the devices, the Primary Core 2 relinquishes its Primary role by resetting itself.

I/O Side Redundancy

The redundancy of the FDC280 pair on the I/O side of the network, coupled with the high coverage of detected faults, provides very high subsystem availability time. Either FDC280 may be replaced without upsetting field I/O signals to the other module. An FDC280 can be removed or replaced without removing power from the FDC280 baseplate.

The Primary FDC280 accesses the field devices for reading and writing I/O points while the Shadow FDC280 uses heartbeat commands to check the connection status of the devices. The Shadow FDC280 is updated with the I/O point values

internally so that if the Primary FDC280 loses connection to one or more devices with the Shadow FDC280 having good connections to all devices, the failover operation occurs with no bump to the process. Field data from the new Primary FDC280 starts flowing into the process as soon as the devices are able to accept new connections for data access.

TIME SYNCHRONIZATION

The Foxboro Evo System supports time synchronization using either an externally maintained optional source of Universal Coordinated Time (UTC) from GPS satellites or an internal source using proprietary software to synchronize the Foxboro Evo Master TimeKeeper which in turn synchronizes the time in the FDC280. All input data from the field is time stamped as it is received by the FDC280, scanned with a minimum scan time of 10 times per second. For more information on time synchronization, refer to *Time Synchronization Overview* (PSS 31S-1TIME).

Time stamping is used for alarm messages, values sent to the Historian, and optionally for the input data from the field when received from the field devices that do not support time stamping.

Time strobe signals are delivered from custom switches over Ethernet cables directly connected to the FDC280 baseplate.

CONTROL FEATURES

The FDC280 performs regulatory, logic, timing, and sequential control, as well as data acquisition, alarm detection, and alarm notification. Process variables are controlled using time-proven algorithms (mathematical computations performing specific functions). The algorithms are contained in functional control blocks, which on-site process engineers configure to implement the desired control strategies.

The versatility of the algorithms provides control

capabilities suited to a broad range of process applications, which allows the FDC280 to scan a high number of external device points. Control strategies ranging from simple feedback and cascade loops to highly sophisticated feedforward, nonlinear, and complex characterization control schemes are readily implemented.

The FDC280 also supports an optional self-hosting mode that allows the FDC280 to start up and run, executing its configured control scheme using the checkpoint file stored in flash memory. This allows the FDC280 to boot itself with a valid control database even if its host workstation is not present.

FDC280 BASEPLATE

The FDC280 is installed on a modular, DIN rail mounted baseplate in a dedicated slot that is keyed for the controller, ensuring the modules cannot be installed in baseplate slots for which they are not designed. The FDC280 baseplate is shown in Figure 1 on page 2.

This 2-position baseplate supports a non-fault-tolerant single or fault-tolerant pair of FDC280s, as well as two copper (RH924UQ) or fiber (RH924WA) adapters, required for connection to the control network.

The FDC280 baseplate provides two 10/100 Mbps or 1 Gbps copper Ethernet RJ-45 connectors for Ethernet connectors to field devices (via customer-supplied Ethernet switches).

The FDC280 baseplates can be added in the field to existing or new configurations. The standard FDC280 baseplates have larger dimensions than the FCP270 or FCP280 standard 2-position baseplates, but use less space than a control processor-and-FBMs solution. The FDC280 baseplate can be installed on either a horizontal or vertical DIN rail, provided that the baseplate itself remains in the orientation shown in Figure 1. However, to meet Marine certification requirements, it must be installed on a horizontal DIN

rail only.

LIQUID CRYSTAL DISPLAY (LCD)

The FDC280 has a liquid crystal display (LCD) on its faceplate, which displays various status and identification information:

- ▶ The first line typically displays the FDC280's letterbug and role (Primary/Shadow/Single), and if the FDC280 is installed in the left-most or right-most slot in its baseplate.
- ▶ The second line displays the FDC280's part number, FDC280 image version, hardware revision information (including manufacture date), and the Foxboro Evo Control Network Ethernet connections status.

LED INDICATORS

Light-emitting diodes (LEDs) on the front of the FDC280 module provide visual indication of the:

- ▶ FDC280 operational status
- ▶ Operational status of the Ethernet connection to the field devices

LED indicators on the copper or fiber network adapters provide visual indication for:

- ▶ Internal and external power supply health status
- ▶ Communications activity to the Control Network A and B links, and to the FDC280(s).

FDC280 FUNCTIONAL SPECIFICATIONS

Processor Type

CONTROL PROCESSOR

Dual core ARM® System on a Chip (SOC) with stored programs, using high-speed communication capability.

ERROR DETECTION

ECC providing single-bit error detection and correction as well as multiple-bit error detection.

Process I/O Capacity

256 field devices

Scan up to 8,000 field points, with a minimum scan time of 100 ms

Memory Allocation for Blocks

22 MB

Maximum Number of Blocks Configured

Supports a maximum of 8,252 blocks including the Station block, ECB compounds, Primary ECBs, and Standard ECBs required to support 256 devices, 8,000 I/O points, and their associated Control blocks. (For sizing guidelines, including examples of valid block count combinations, refer to *Field Device Controller 280 (FDC280) Sizing Guidelines and Excel Workbook* (B0700GS).)

Block Executions Per Second

16,000 blocks/second, maximum

Maximum Number of Blocks Processed

The number of blocks that can be processed per block processing cycle (BPC) time interval depends on scan periods and block type selection. These blocks include all types (control blocks, ECBs, compounds, data blocks, and so forth). For sizing guidelines, refer to *Field Device Controller 280 (FDC280) Sizing Guidelines and Excel Workbook* (B0700GS).

Minimum Block Processing Cycle (BPC)

100 ms

Sequence Block Size


32 KB maximum for each block

Time to Marry Fault-Tolerant Modules

Less than 0.5 seconds

Maximum Number of IPC Connections

231; 200 connections for source points; 30 connections for sink points; 1 connection for internal use only.



An IPC connection provides the means to exchange continuous process control information.

A Source point is defined as a connection to a destination device that can have data sourced by a given CP. Thus an FDC280 can provide data to up to 200 destination stations.

A Sink point is defined as an external point to which the FDC280 can connect to acquire process control data. The FDC280 can receive continuous updates from up to 30 other data sources.

Maximum Number of OM Sink Lists

75

A Sink list is a list of items to be delivered to a particular destination. These lists provide an efficient way to group updates to a given destination.

Maximum OM Scanner Database

28,000 maximum points.

18,000 points/second, maximum rate of OM scanner change before ignition of throttling mechanism.

18,000 points for BPC $\geq$ 200 ms

7,500 points for BPC = 100 ms

The Object Manager (OM) scanner database is the total of all points in the control scheme for which the FDC280 is scanning and providing updates to other stations.

Maximum Number of OM Sink Points

11,250

The OM sink point limitations refer to the number of points that can be received from outside sources.

Configurable Block Periods

0.1, 0.2, 0.5, 0.6, 1, 2, 5, 6, 10, 30 seconds

1, 10, 60 minutes

Block Processing Cycle

0.1, 0.2, 0.5 and 1.0 seconds, selectable at system configuration time

FDC280 FUNCTIONAL SPECIFICATIONS (CONTINUED)

Internal Diagnostics

Self-checking performed at power-up. Run-time diagnostics performed during normal operations. When FDC280s are configured as an fault-tolerant pair, constant synchronization checking and message compare operations for messages communicated over the control network are also used to detect hardware faults.

Power Requirements

INPUT VOLTAGE (REDUNDANT VOLTAGE)

24 V dc typical

CONSUMPTION (PER NON-REDUNDANT MODULE)

8.5 W, maximum

RoHS Compliance

Complies with
European RoHS Directive 2011/65/EU.

Regulatory Compliance

ELECTROMAGNETIC COMPATIBILITY (EMC)

EMC Directive 2014/30/EU

Meets: EN 61326-1 Class A Emissions and Industrial Immunity Levels.

PRODUCT SAFETY

Underwriters Laboratories (UL) for U.S. and Canada

Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in Class I, Groups A-D; Division 2; enclosure based systems when installed as described in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA)

Communications circuits also meet the requirements for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA).

Regulatory Compliance (Continued)

European Low Voltage Directive

2014/35/EU and Explosive Atmospheres (ATEX) Directive 2014/34/EU

ATEX (DEMKO) Ex nA IIC T4 Gc certified when installed as described in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA). For use in an enclosure suited for an ATEX Zone 2 classified area.

SECURITY

ISASecure™ Certification, EDSA Level 1

FDC280 ENVIRONMENTAL SPECIFICATIONS⁽¹⁾

Operating

TEMPERATURE

-20 to 60°C (-4 to 140°F)

RELATIVE HUMIDITY

5 to 95% (Noncondensing)

ALTITUDE

Up to +3,000 m (+10,000 ft)

CONTAMINATION

Class G3 (Harsh) as defined in ISA Standard, S71.04. No effect on functionality after simulated 10-year exposure to mixed gas testing per EIA Standard 364-65A, Class III.
The FDC280 has Conformal Coating.

VIBRATION

0.5 g (5 to 500 Hz)

Storage

TEMPERATURE

-40 to +70°C (-40 to +158°F)

RELATIVE HUMIDITY

5 to 95% (Noncondensing)

ALTITUDE

-300 to +12,000 m (-1,000 to +40,000 ft)
Per MIL-STD 810G, method 500.5, PI

(1) The environmental limits of this module may be enhanced by the type of enclosure containing the module. (Refer to the applicable Product Specification Sheet (PSS) which describes the specific type of enclosure that is to be used.)

FDC280 PHYSICAL SPECIFICATIONS

Configuration

Single processor module. The fault-tolerant version consists of two processor modules, with an interconnecting fault-tolerant connector integral to the baseplate.

Mounting

May be placed in device specific 2-position baseplates designed for horizontal or vertical mounting.

For the fault-tolerant FDC280, the two modules must be mounted in dedicated slots to allow for interconnecting fault-tolerant communication and to allow for the proper airflow to cool the modules.

Dimensions - Module

HEIGHT

105 mm (4.13 in)

116 mm (4.59 in) including mounting lugs

WIDTH

51.8 mm (2.04 in)

DEPTH

147 mm (5.80 in)



Figure 9. FDC280 Dimensions

Weight (Maximum)

MODULE

0.8 kg (1.78 lb) for a single, non-fault-tolerant module.

TERMINATION ASSEMBLIES FOR SERIAL COMMUNICATIONS

Ring Lug (P0926PA)⁽²⁾

363 g (0.8 lb) approximate

Compression Screw (RH926GH)

272 g (0.6 lb) approximate

Part Numbers

FDC280

RH101FQ

FDC280 BASEPLATE

RH101KF

FIBER ADAPTER

RH924WA (Rev. E or later)

COPPER ADAPTER

RH924UQ (Rev. D or later)

TERMINATION ASSEMBLIES FOR SERIAL COMMUNICATIONS

TA Ring Lug - P0926PA⁽²⁾

TA Compression Screw - RH926GH (supersedes P0926GH)

⁽²⁾ This is not a RoHS part.

FDC280 PHYSICAL SPECIFICATIONS (CONTINUED)

Control Network Ethernet Switch to FDC280 Cabling

CABLING CONNECTORS

Fiber Adapter

Two ceramic type LC connectors on one end
(for network adapters) with an MT-RJ
connector on the other end (for switch)

Copper Adapter

RJ-45 connectors on both ends

FIBER OPTIC CABLE

Cable Material

Multimode fiber (MMF) 62.5/125 μ m plenum

Cable Lengths

Up to 50 m (164 ft) – Foxboro supplied.

Refer to “Network Cabling for FDC280
Network Adapters” in B0700GQ for the
appropriate specifications of allowed fiber
optic cabling.

Greater than 50 m – user supplied

Maximum Length

2 km (6,560 ft) from the Ethernet switch to
the FDC280.

COPPER CABLE

Cable Material

1000Base-T Cat 5 copper Ethernet cable

Cable Lengths

Up to 100 m (328 ft) – Foxboro supplied.

Refer to “Network Cabling for FDC280
Network Adapters” in B0700GQ for the
appropriate specifications of allowed copper
cabling.

Maximum Length

100 m (328 ft) from the Ethernet switch to
the FDC280.

Field Device Ethernet Switch to FDC280 Cabling

CABLING CONNECTORS

10/100 Mbps or 1 Gbps copper Ethernet RJ-45
connectors on both ends

COPPER CABLE

Cable Material

1000Base-T Cat 5e or Cat 6 copper
Ethernet cable

Cable Lengths

Up to 100 m (328 ft) – Foxboro supplied.

Refer to “Network Cabling for FDC280
Network Adapters” in B0700GQ for the
appropriate specifications of allowed copper
cabling.

Maximum Length

100 m (328 ft) from the Ethernet switch to
the FDC280.

FDC280 to Termination Assembly Serial Cabling

Use the Compact Type 5 cables in Table 1 to connect
the FDC280's baseplate to the termination
assemblies for Serial connections.

**Table 1. Termination Cables (Type 5) for the
FDC280 Serial Termination Assemblies**

Cable Part Number	Length
RH100HV	1.0m (3.3 ft)
RH100HW	1.5m (4.9 ft)
RH100HX	2.0m (6.6 ft)
RH100HY	3.0m (9.8 ft)
RH100HZ	5.0m (16.4 ft)

FDC280 PHYSICAL SPECIFICATIONS (CONTINUED)

FDC280 to Termination Assembly Serial Cabling (Cont.)

Table 2. RS-232 Communication Cables, Single Ported Device to Single TA (Simplex FDC280)

Option	Length	Cable Part Number
RS-232 VT100	6m (20 ft)	RH970XD
	12m (40 ft)	RH970WY
RS-232 Modem	6m (20 ft)	RH970XC
	12m (40 ft)	RH970WX
DCE (Local)	6m (20 ft)	RH970XD
	12m (40 ft)	RH970WY

Table 3. RS-232 Communication Cables, Single Ported Device to Two TAs (Fault Tolerant FDC280)

Option	Length	Cable Part Number
RS-232 Y-Cable	6m (20 ft)	RH100MM
	12m (40 ft)	RH100MP

BUS CHARACTERISTICS

General

Electronic Industrial Association (EIA)
RS-232, RS-422 or RS-485 communications
selectable on a per port basis. The RS-485
physical communication medium consists of
twisted-pair shielded copper cable
containing a single conductor pair. The
RS-422 is a 4-wire physical communication
medium. The RS-232 physical
communication medium is a DB-25 cable to
a customer supplied
device/modem/converter.

EIA RS-232, RS-422 and RS-485 I/O Communication

Asynchronous communication, direct
connect link (RS-232).
Transmission Rate
300, 600, 1200, 2400, 4800, 9600,
19200, 38400, 57600 and 115200 baud.
Protocol
8-bit characters; odd, even or no parity, 1 or
2 stop bits.

FDC280 BASEPLATE FUNCTIONAL SPECIFICATIONS

Power Requirements

INPUT VOLTAGE RANGE (REDUNDANT)

24 V dc +5%, -10%

POWER CABLING

Cable Lengths

0.4 m (16 in) up to 2.1 m (7 ft)

Regulatory Compliance

ELECTROMAGNETIC COMPATIBILITY (EMC)

EMC Directive 2014/30/EU

Meets: EN 61326-1 Class A Emissions and Industrial Immunity Levels.

PRODUCT SAFETY

Underwriters Laboratories (UL) for U.S. and Canada

Underwriters Laboratories (UL) for U.S. and Canada UL/UL-C listed as suitable for use in Class I, Groups A-D; Division 2; enclosure based systems when installed as described in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA)

Communications circuits also meet the requirements for Class 2 as defined in Article 725 of the National Electrical Code (NFPA No.70) and Section 16 of the Canadian Electrical Code (CSA C22.1). Conditions for use are as specified in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA).

European Low Voltage Directive 2014/35/EU and Explosive Atmospheres (ATEX) Directive 2014/34/EU

ATEX (DEMKO) Ex nA IIC T4 Gc certified when installed as described in the *Standard and Compact 200 Series Subsystem User's Guide* (B0400FA). For use in an enclosure suited for an ATEX Zone 2 classified area.

FDC280 BASEPLATE ENVIRONMENTAL SPECIFICATIONS⁽³⁾

Operating

TEMPERATURE

-20 to +70° C (-4 to +158° F)

RELATIVE HUMIDITY

5 to 95% (noncondensing)

ALTITUDE

-300 to +3,000 m (-1,000 to +10,000 ft)

Storage

TEMPERATURE

-40 to +70° C (-40 to +158° F)

RELATIVE HUMIDITY

5 to 95% (noncondensing)

ALTITUDE

-300 to +12,000 m (-1,000 to +40,000 ft)

Contamination (Non-Enclosure Mounted)

Class G3 (Harsh) as defined in ISA Standard S71.04

Contamination (Enclosure Mounted)

Class G3 (Harsh) as defined in ISA Standard S71.04.
Pollution degree 2 as defined in IEC 664-1.

FDC280 BASEPLATE PHYSICAL SPECIFICATIONS

Mounting

DIN RAIL

FDC280 baseplates mount on a non-isolated, mechanically supported vertical or horizontal DIN rail, which can be internal to, or external to an enclosure. The FDC280 baseplate attaches to the DIN rail by means of fasteners. However, to meet Marine certification requirements, the baseplate must be installed on a horizontal DIN rail only.

RACK MOUNT

A mounting kit (P0930AS) is available for horizontal mounting of the FDC280 baseplate in a standard, 483 mm (19-inch) rack. This kit provides a 25.4 mm (1 inch) mounting depth.

Rack Mounting Bracket

Material: Steel, Cold-Rolled, 0.0598 mm (16 Gauge)

Mass (Without Modules)

~0.53 kg (1.17 lb)

Size

HEIGHT

150 mm (5.9 in)

WIDTH

216 mm (8.5 in)

DEPTH

31.4 mm (1.24 in)

39.7 mm (1.56 in) including feet

Construction

MATERIAL

PC and ABS, inflammability UL94 V0


COLOR

Black

(3) The environmental limits of the 200 Series baseplates may be enhanced by the type of enclosure containing the 200 Series baseplate. Refer to the applicable Product Specification Sheet (PSS) which describes the specific type of enclosure that is to be used.


DIMENSIONS - NOMINAL

Compression Screw Termination Assembly RH926GH

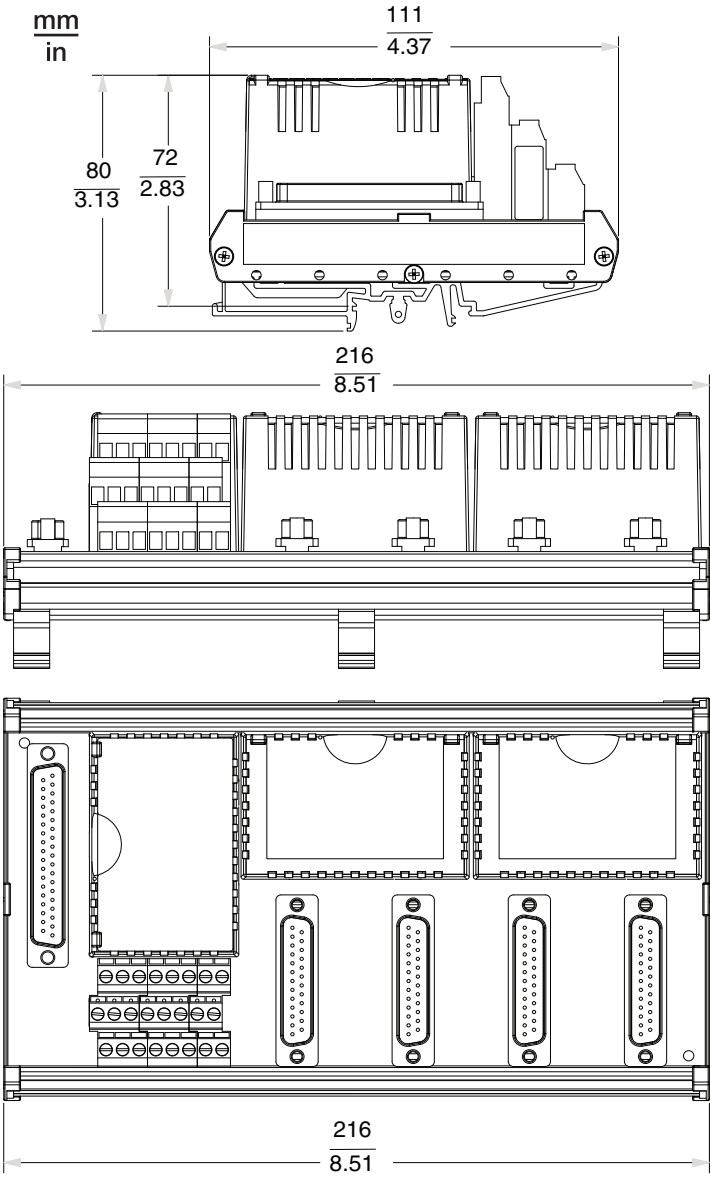

DIMENSIONS - NOMINAL (CONTINUED)

Ring Lug Termination Assembly (P0926PA)⁽⁴⁾

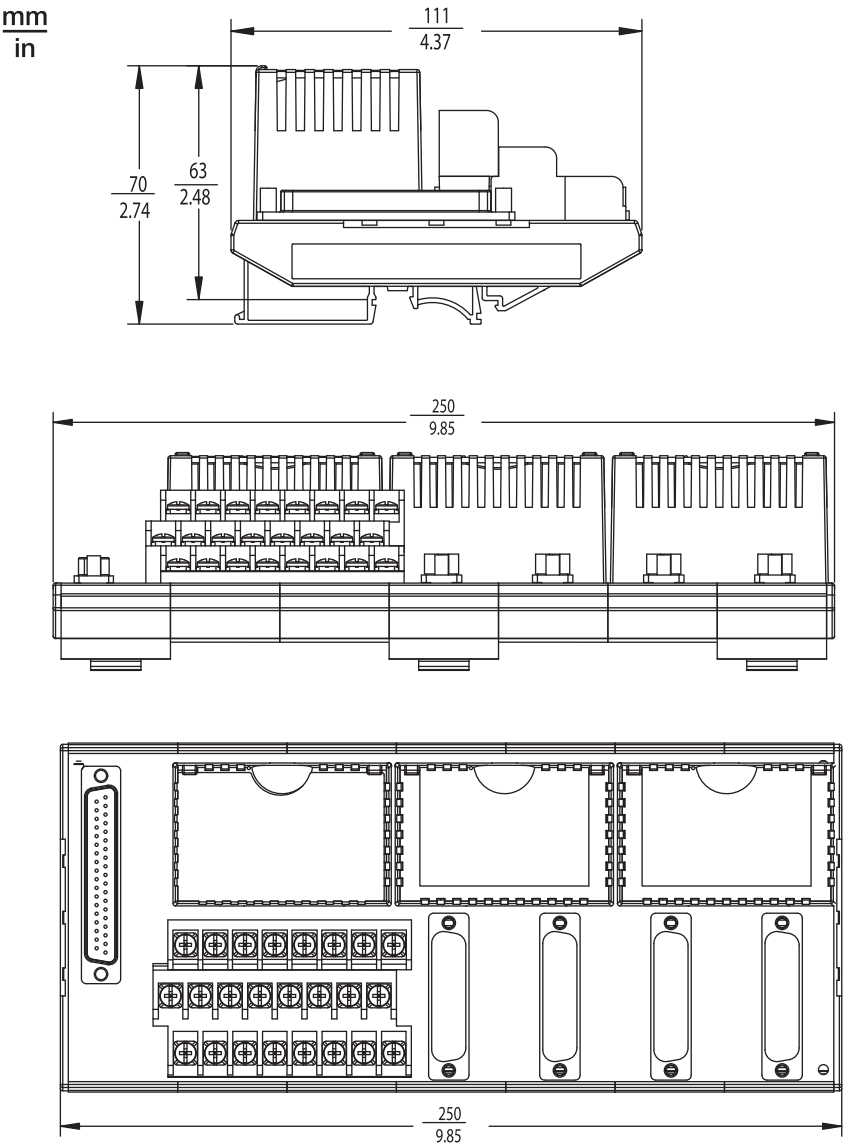

⁽⁴⁾ This not a RoHS part.

RELATED PRODUCT SPECIFICATION SHEETS

For reference purposes, Table 4 lists the Product Specification Sheets (PSSes) for additional hardware and software elements in the 200 Series subsystem.

Table 4. Related Product Specification Sheets

PSS Number	Title
PSS 31H-2SOV	Standard 200 Series Subsystem Overview
PSS 31H-2CERTS	Standard and Compact 200 Series I/O - Agency Certifications
PSS 31H-2W3	Standard 200 Series Power Supply
PSS 31H-2SBASPLT	Standard 200 Series Baseplates
PSS 31H-2FPS	Standard 200 Series Power Supplies - FPS240-24 and FPS120-24
PSS 31H-2W12 B3	DIN Rail Mounted High Density I/O Equipment, Agency Certifications
PSS 31H-2C480 B4	Compact Power Supply - FPS480-24
PSS 31H-2GOV	G-Series Enclosures Overview
PSS 31H-7NwEquip	The Foxboro Evo Control Network Ethernet Equipment
PSS 31S-1TIME	Time Synchronization Overview
PSS 31S-3FCPICS	Field Control Processor 280 (FCP280) Integrated Control Software
PSS 31S-3FDCMBDV	Modbus Master TCP Driver for Field Device Controller 280
PSS 31S-3FDCMBRT	Modbus Master RTU Serial Driver for Field Device Controller 280